
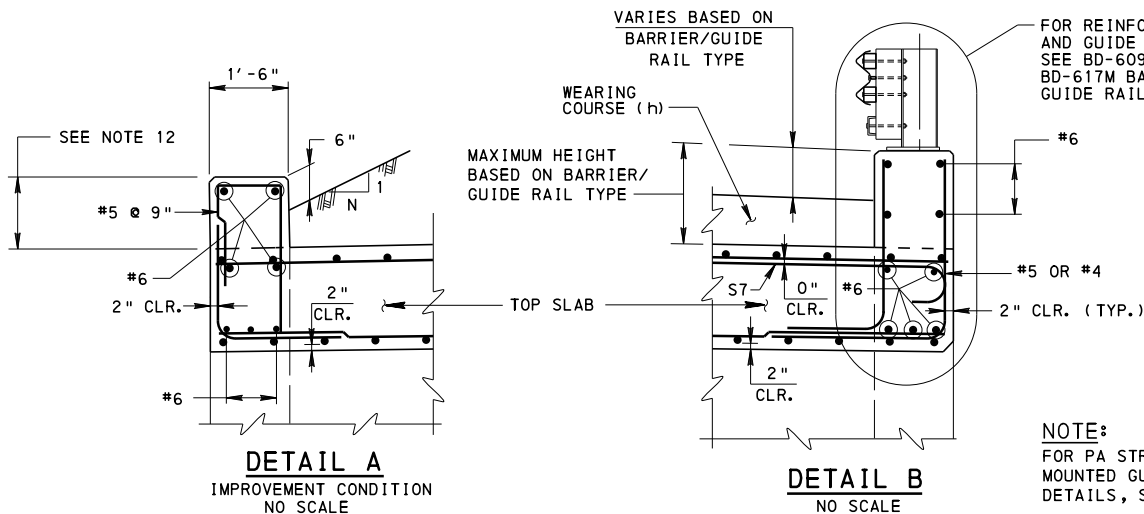
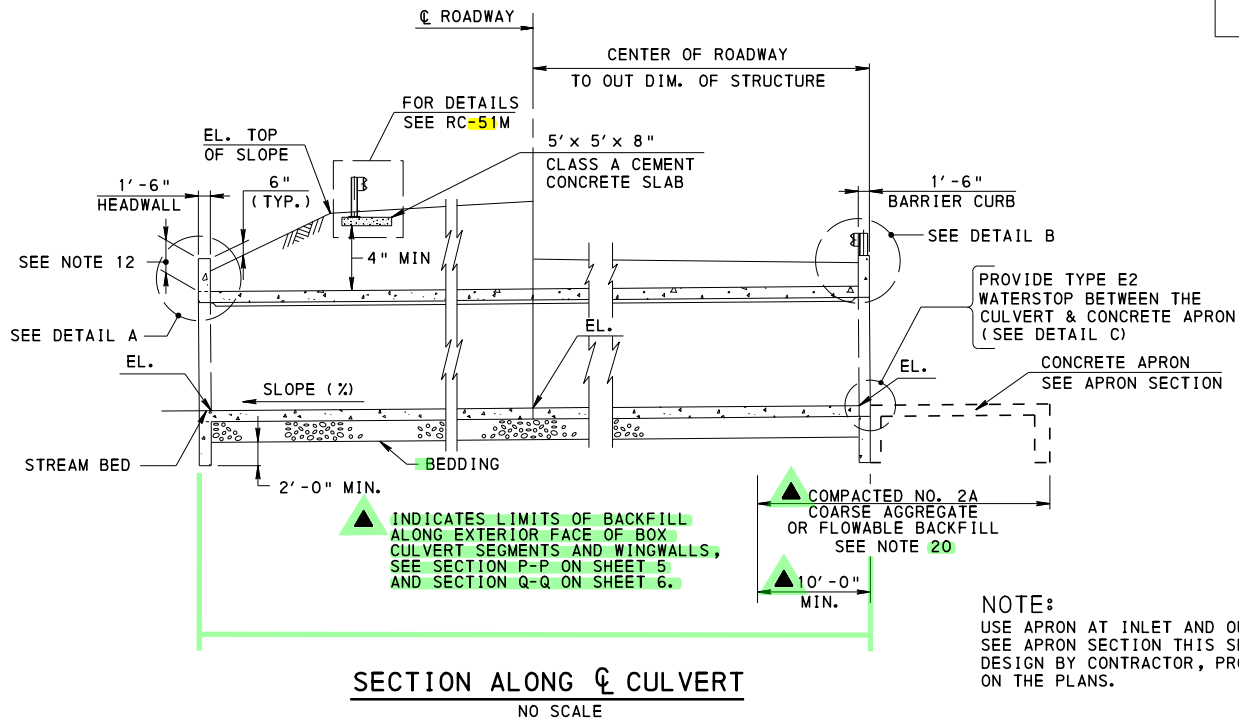


NOTE: e-Notification  
revision on sheet 14

CHANGE 1

CHANGE 2


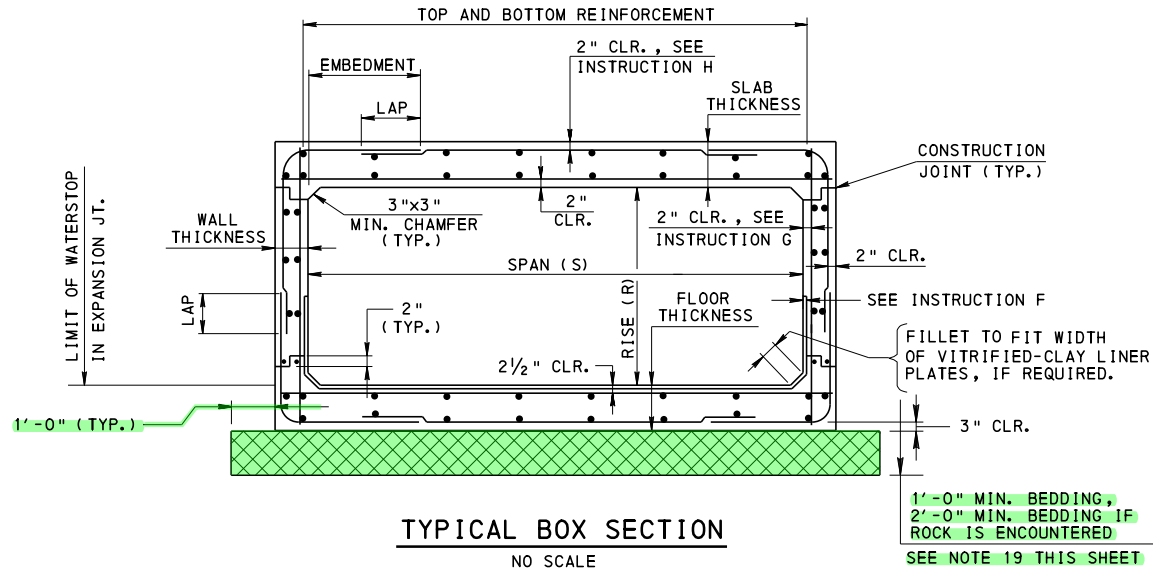


### DESIGN DATA FOR CAST-IN-PLACE BOX CULVERT

- $f'c = 3000$  P.S.I. FOR CLASS A CEMENT CONCRETE
- $f'c = 4000$  P.S.I. FOR TOP SLAB AT GRADE (CLASS AAAP CEMENT CONCRETE)
- $f_y = 60,000$  P.S.I. FOR REINFORCEMENT BARS
- $f_y = 65,000$  P.S.I. FOR WELDED WIRE FABRIC

### INSTRUCTIONS

- MINIMUM SLAB THICKNESS = 10"
- MINIMUM WALL THICKNESS = 10" FOR RISE  $< 5'-0"$
- MINIMUM WALL THICKNESS = 1'-0" FOR RISE  $> 5'-0"$
- ADD 1 1/2" (1/2" AT THE TOP AND 1" AT BOTTOM) TO THE EFFECTIVE DESIGN THICKNESS OF BOTTOM SLAB OF BOX CULVERTS, FOR THE TOTAL (PROVIDED) THICKNESS.
- FOR BOX CULVERTS AT GRADE, ADD 1/2" INTEGRAL WEARING SURFACE TO THE TOP DECK SLAB THICKNESS.
- IF SPECIFIED, VITRIFIED-CLAY LINER PLATES WITH TYPE B POINTING (INCLUDE COST IN THE PRICE OF CONCRETE TO WHICH ATTACHED.)
- 3" CLEAR IF LINER PLATES ARE USED
- 2 1/2" CLEAR IF AT GRADE
- PLACE MAIN CIRCUMFERENTIAL REINFORCEMENT NORMAL TO THE CENTERLINE OF THE CULVERT.
- PROVIDE EXPANSION JOINTS AT APPROXIMATELY 90' INTERVALS AND CONSTRUCTION JOINTS AT APPROXIMATELY 30' INTERVALS. PROVIDE EXPANSION JOINTS IN BOTTOM SLAB.

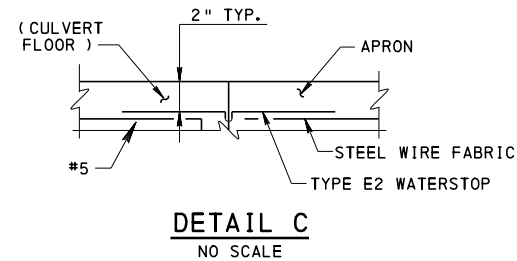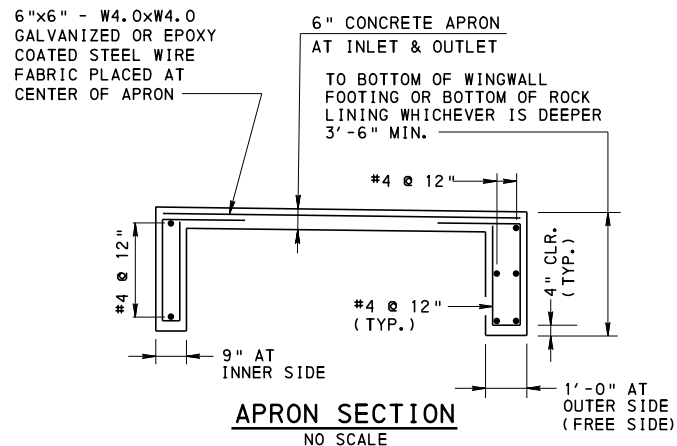

### NOTES

- PROVIDE GRADE 60 DEFORMED REINFORCING BARS THAT MEET THE REQUIREMENTS OF ASTM A 615, A 996 OR A 706. DO NOT WELD REINFORCEMENT STEEL. DO NOT USE RAIL STEEL (A 996) WHERE BENDING OR WELDING OF REINFORCEMENT BARS IS INDICATED.
- DESIGN SPECIFICATIONS: AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS AND AS SUPPLEMENTED BY THE DESIGN MANUAL, PART 4, STRUCTURES.
- PROVIDE MATERIALS AND **WORK QUALITY** IN ACCORDANCE WITH THE APPROPRIATE SPECIFICATIONS AS OUTLINED IN THE PENNSYLVANIA DEPARTMENT OF TRANSPORTATION PUBLICATION 408.
- DEAD LOADS: INCLUDES SURFACE AREA DENSITY OF 30 P.S.F. FOR FUTURE WEARING SURFACE FOR BOXES AT GRADE.
- USE EPOXY COATED REINFORCEMENT BARS IN THE FOLLOWING CONDITIONS:
  - TOP SLAB AND HEADWALL WITHIN 2'-0" OF GRADE.
  - ALL CURBS AND BARRIERS.
  - THROUGHOUT THE CULVERT WHEN VITRIFIED CLAY LINER PLATES ARE USED.
  - IN ALL APRON SLABS.
- PROVIDE 2" CONCRETE COVER ON REINFORCEMENT BARS EXCEPT AS NOTED.
- FOR HYDRAULIC DESIGN REFER TO DESIGN MANUAL, PART 2.
- FOR LOW FLOW FISH PASSAGE DESIGN COMMENTARY REFER TO DESIGN MANUAL, PART 2.
- INDICATE ALLOWABLE AND MAXIMUM DESIGN FOUNDATION PRESSURE ON THE PLANS.
- PLACE HEADWALLS, APRON WALLS AND WINGWALL FOOTINGS BELOW FROST DEPTH OR 3'-6" WHICHEVER IS GREATER.
- USE 4" Ø FORMED WEEP HOLES AT 15'-0" MAXIMUM CENTERS PLACED AT A MINIMUM 1'-9" ABOVE BOTTOM OF SLAB OR 6" ABOVE NORMAL FLOW LINE, FOR DETAILS SEE BC-751M. FOR WEEP HOLES LOCATED IN THE COMPACTED NO. 2A COARSE AGGREGATE AREAS OR FLOWABLE BACKFILL AREAS, PROVIDE PREFORMED DRAIN CONFORMING TO PUB. 408 SECTION 623.2(a), WHICH IS 2'-0" MINIMUM HIGH x 4'-0" WIDE CENTERED HORIZONTALLY ON WEEP HOLE, SEE PREFORMED DRAIN DETAIL ON SHEET 5.
- CONCRETE HEADWALL REINFORCEMENT WILL REQUIRE A SEPARATE DESIGN IF HEIGHT IS GREATER THAN 2'-0".
- USE THIS STANDARD DRAWING IN CONJUNCTION WITH THE APPLICABLE ROADWAY CONSTRUCTION STANDARDS FOR GUIDE RAIL.
- REFER TO DESIGN DRAWINGS FOR SPACING OF POSTS.
- THOROUGHLY COAT ALL SURFACES OF THE BASE PLATES IN CONTACT WITH CONCRETE WITH CAULKING COMPOUNDS PRIOR TO ERECTION. AFTER ERECTION AND ALIGNMENT, SEAL OPENINGS BETWEEN THE METAL SURFACES AND THE CONCRETE WITH CAULKING COMPOUND MEETING THE REQUIREMENTS OF SECTION 705, PUB. 408.
- FOR JOINT DETAILS SEE BC-735M. WHEN EXPANSION JOINTS ARE USED, WATERSTOPS ARE REQUIRED IN THE TOP AND BOTTOM SLABS AND THE WALLS.
- FOR SAFETY WING DETAILS, SEE SHEET 3.
- MODIFIED STRUCTURE MOUNTED GUIDE RAIL BARRIER GRANTED TL3 DESIGNATION BY FHWA.
- INDICATES ADDITIONAL EXCAVATION FOR BEDDING MATERIAL BELOW THE BOTTOM OF R.C. BOX CULVERT WITH LIMITS AS SHOWN. BACKFILL WITH 2A OR #8 COARSE AGGREGATE. LEVEL BEARING AREA FOR PRECAST BOX SEGMENT WITH MINIMUM THICKNESS OF FINE AGGREGATE.
- PROVIDE COMPACTED NO. 2A COARSE AGGREGATE BACKFILL OR TYPE B FLOWABLE BACKFILL AT INLET END OF CULVERTS FOR A MINIMUM LENGTH OF 10'-0" PLUS WINGWALLS. HEIGHT OF COMPACTED NO. 2A COARSE AGGREGATE OR FLOWABLE BACKFILL IS A MINIMUM OF 2'-0" ABOVE NORMAL STREAM. ELEVATION EXTENDING TO THE BOTTOM OF WINGWALL FOOTING OR BOTTOM OF ROCK LINING WHICHEVER IS DEEPER, 3'-6" MINIMUM.
- CLASS A TYPE 4 GEOTEXTILE IS PERMITTED TO BE PLACED BETWEEN THE BEDDING MATERIAL AND EXCAVATION OR TO ENCASE THE BEDDING MATERIAL.

### LEGEND

E.F. : DENOTES EACH FACE  
F.F. : DENOTES FRONT FACE  
R.F. : DENOTES REAR FACE  
EL. : DENOTES ELEVATION  
C.I.P. : DENOTES CAST-IN-PLACE  
B.B. : DENOTES BACK BATTER



**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
BUREAU OF PROJECT DELIVERY

STANDARD  
R.C. BOX CULVERT  
CAST-IN-PLACE

RECOMMENDED AUG. 30, 2019  
ACTING CHIEF BRIDGE ENGINEER  
RECOMMENDED AUG. 30, 2019  
ACT. DIR., BUR. OF PROJECT DELIVERY  
SHEET 1 OF 15  
BD-632M

RC-51M	TYPE 31 STRONG POST GUIDE RAIL
BD-601M	CONCRETE DECK SLAB
BD-609M	PA STRUCTURE MOUNTED GUIDE RAIL BARRIER
BD-610M	PA BRIDGE BARRIER
BD-617M	PA TYPE 10M BRIDGE BARRIER
BD-621M	REINFORCED CONCRETE ABUTMENTS
BD-625M	WINGWALL LENGTH
BD-631M	END WALL DETAILS
BC-706M	PA STRUCTURE MOUNTED GUIDE RAIL BARRIER
BC-734M	ANCHOR SYSTEMS
BC-735M	WALL CONSTRUCTION AND EXPANSION JOINT DETAILS
BC-736M	REINFORCEMENT BAR FABRICATION DETAILS
BC-739M	BRIDGE BARRIER TO GUIDE RAIL TRANSITION
BC-751M	BRIDGE DRAINAGE
BC-788M	TYPICAL WATERPROOFING AND EXPANSION DETAILS
BC-798M	MECHANICAL CONNECTION DETAILS

REFERENCE DRAWINGS

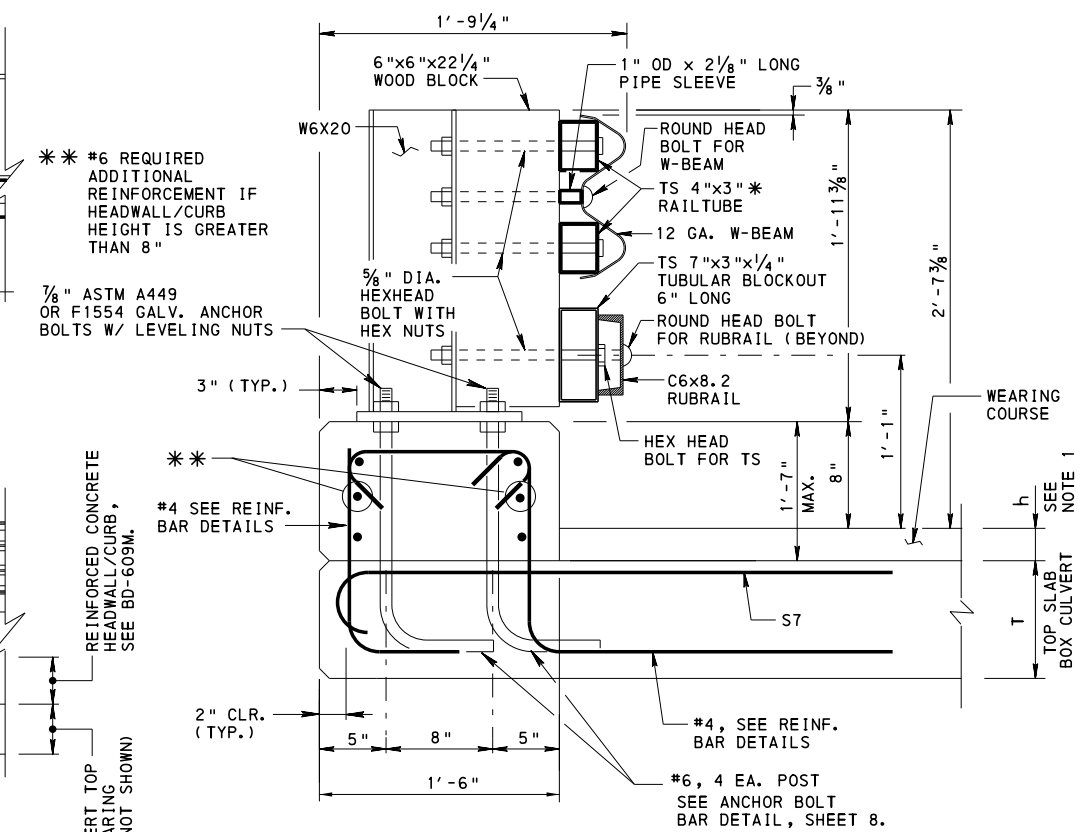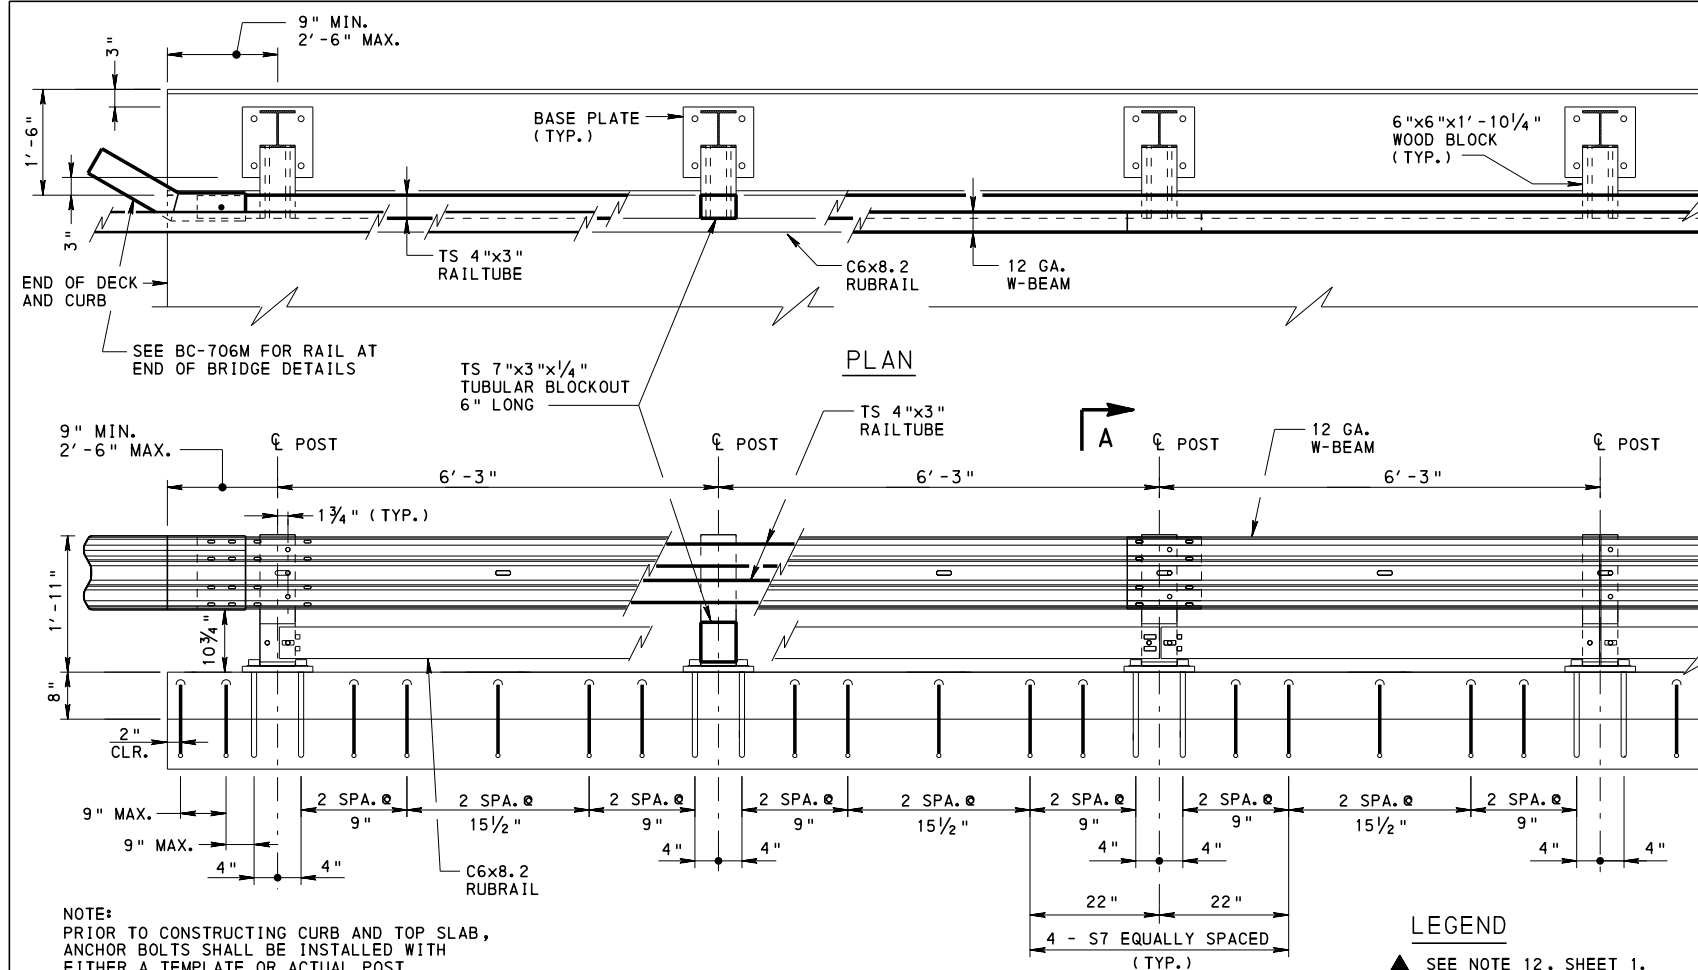

SECTION A-A

\* FOR TUBE THICKNESS SEE TUBE RAIL SPECIFICATIONS TABLE ON BC-706M.




- CURB REINFORCEMENT SHOWN FOR CLARITY, SEE BD-609M.
- SEE RC-51M FOR TYPE 31 STRONG POST GUIDE RAIL DETAILS
- S7 REINFORCEMENT REQUIRED AT POST LOCATIONS ONLY.  
SEE SHEET 8 FOR SLAB REINFORCEMENT BAR DETAILS.

LEGEND

- ▲ SEE NOTE 12, SHEET 1.

NOTES:

1. 2½" MIN., 11" MAX. TOTAL WEARING COURSE THICKNESS (h) (COMBINATION FILL AND OVERLAY)
2. SEE DETAIL B SHEET 1 FOR ALTERNATE DETAIL.
3. SEE BD-601M FOR BARRIER REINFORCEMENT AND DIMENSION DETAILS.

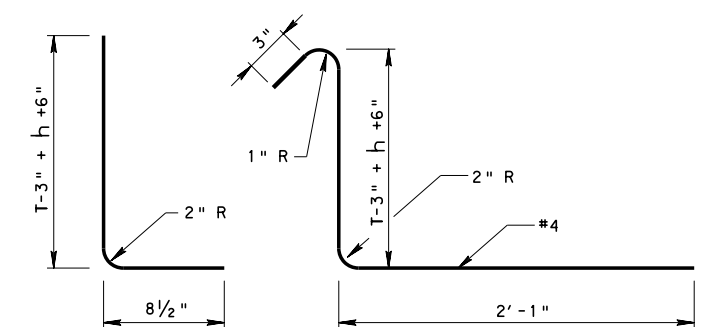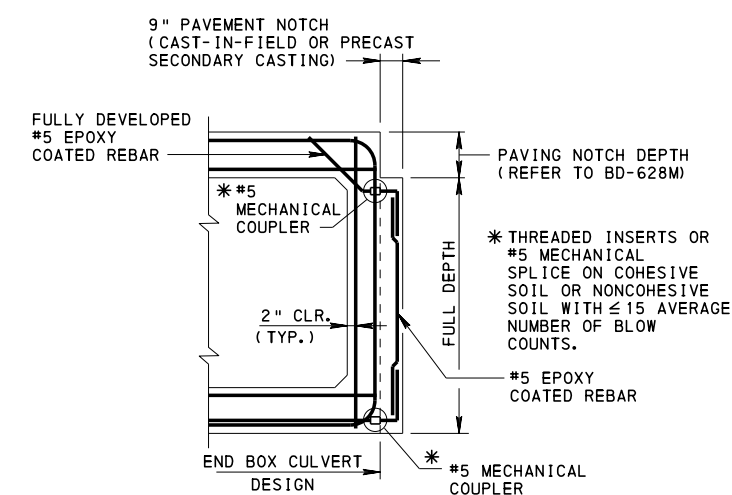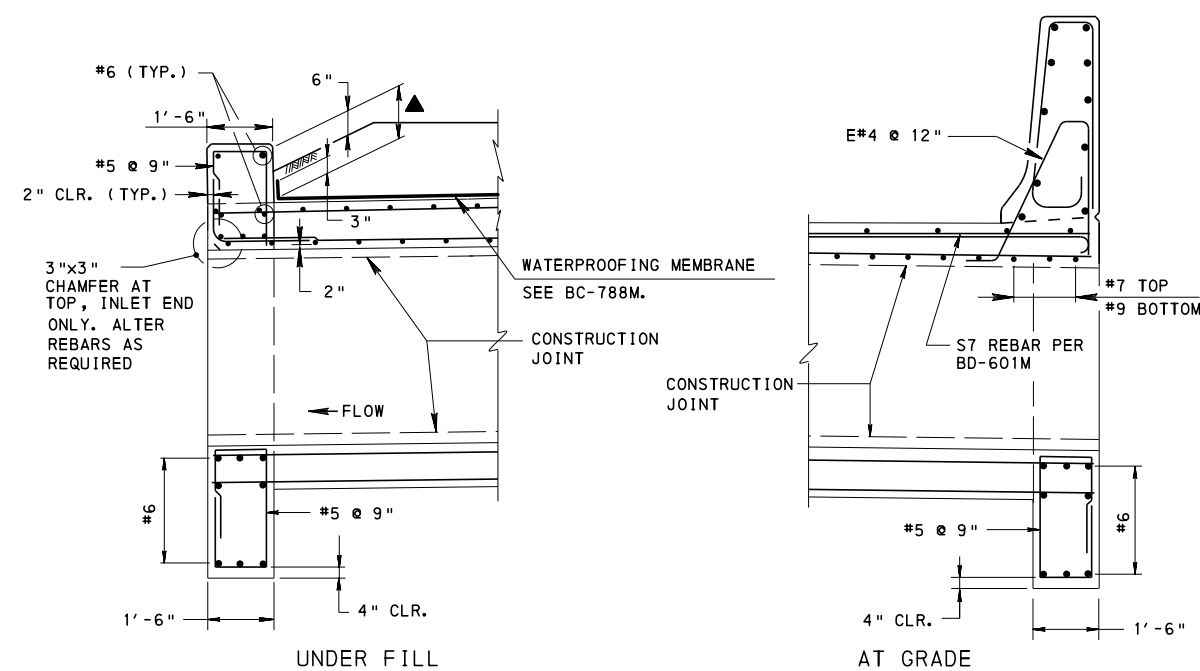

**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
**BUREAU OF PROJECT DELIVERY**


STANDARD  
R. C. BOX CULVERT  
HEADWALL DETAILS  
CAST-IN-PLACE

RECOMMENDED AUG. 30, 2019  
*Louis J. Russo*  
 ACTING CHIEF BRIDGE ENGINEER

RECOMMENDED AUG. 30, 2019  
*Melvin D. Bates*  
 ACT. DIR., BUR. OF PROJECT DELIVERY


SHEET 2 OF 15

BD-632M

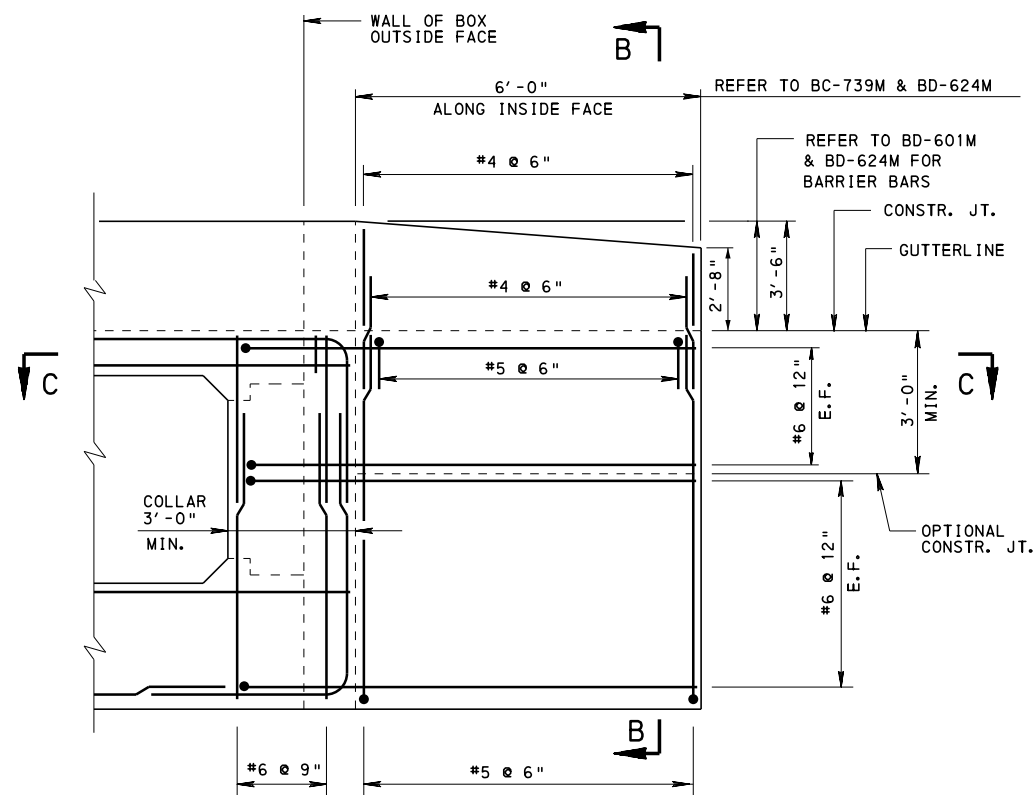


### TYPICAL HEADWALL ELEVATION - FLARED SAFETY WING

NOTE: HOOKS ON BARS EXTENDING FROM BARRIER TRANSITION INTO THE COLLAR MAY BE TURNED IN ANY DIRECTION.

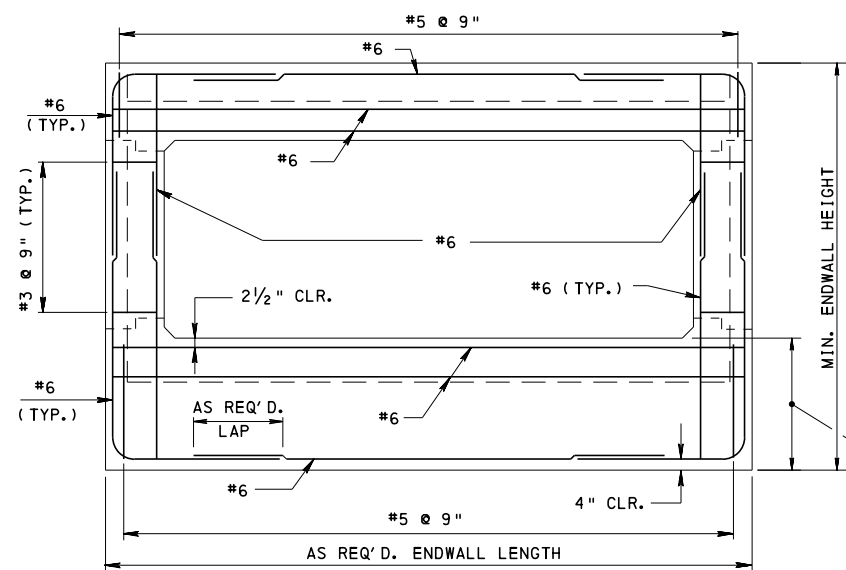


### TYPICAL HEADWALL ELEVATION

MINIMUM REINFORCEMENT SHOWN  
NO SCALE

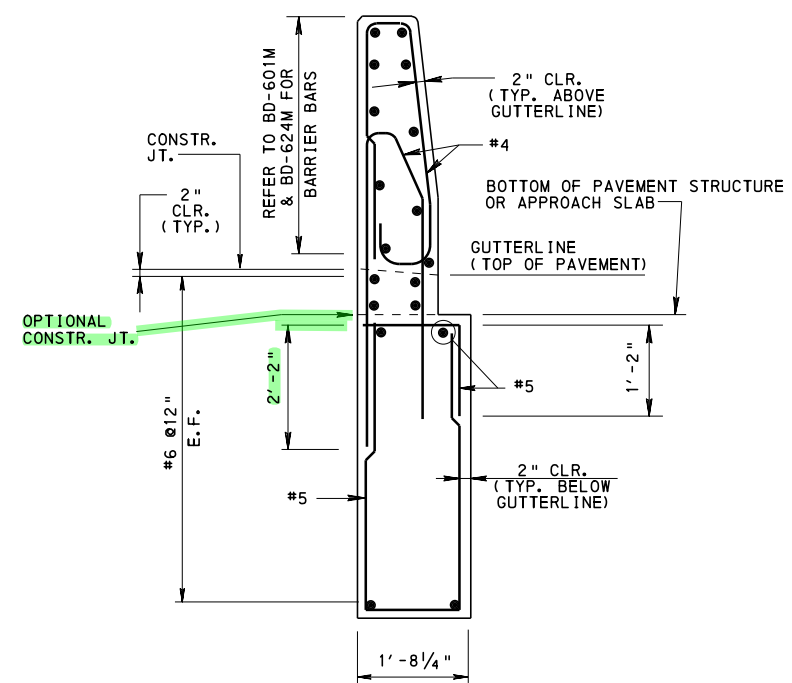


### SECTION B-B

(WITHOUT CURB BLOCK)

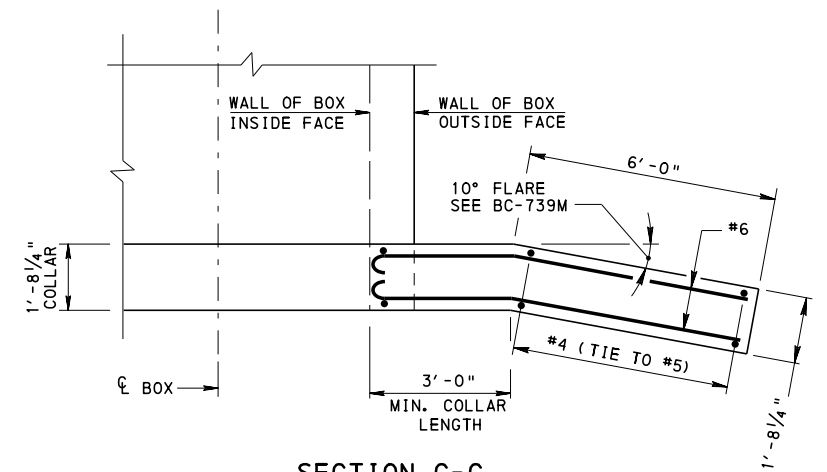


### SECTION C-C

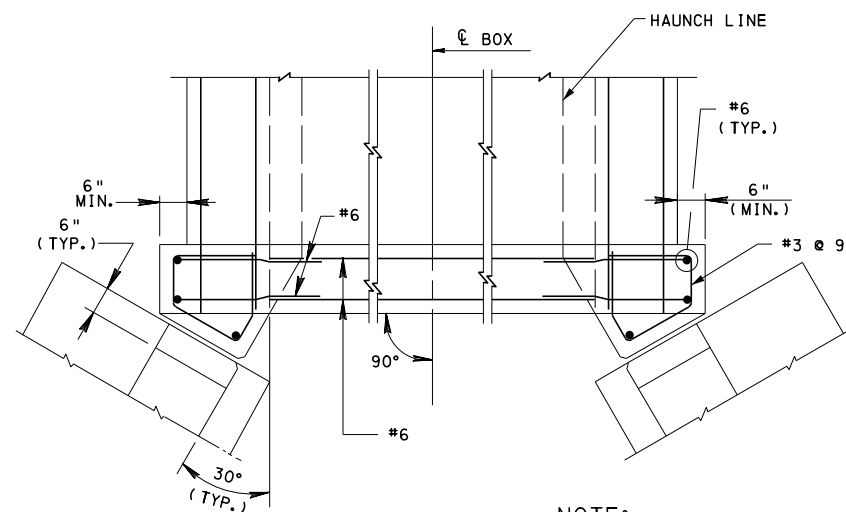

NOTE: FOR TYPICAL WING DETAILS SEE SHEET 5.

### TYPICAL CULVERT HEADWALL DETAILS

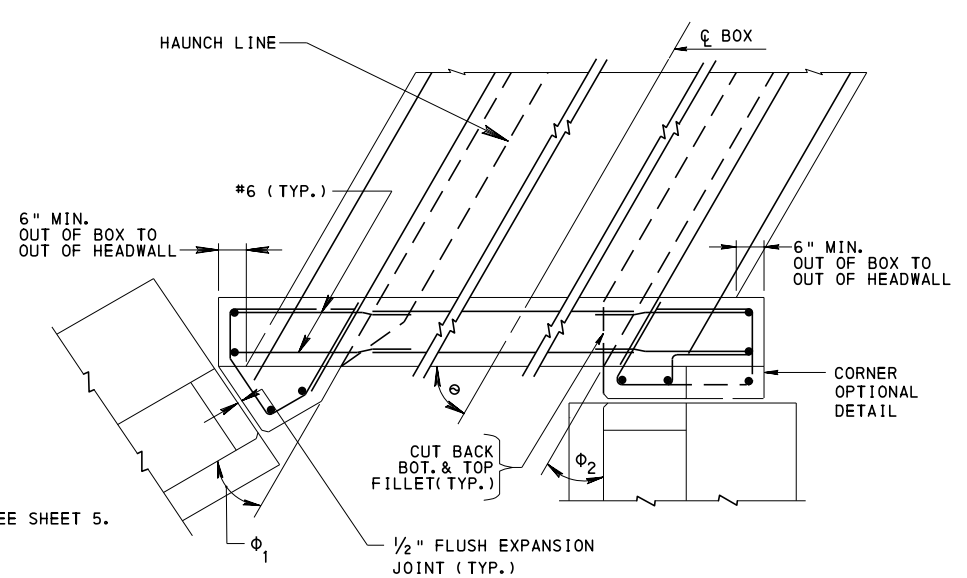

### LEGEND:

- $\Theta$  = SKEW ANGLE
- $\phi_1$  = 30° FOR  $\Theta \geq 60^\circ$
- $\phi_1$  =  $\frac{\Theta}{2}$  FOR  $\Theta < 60^\circ$
- $\phi_2$  = 30° FOR  $\Theta \geq 60^\circ$
- $\phi_2$  =  $90^\circ - \Theta$  FOR  $\Theta < 60^\circ$


COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R. C. BOX CULVERT  
CAST-IN-PLACE

RECOMMENDED AUG. 30, 2019  
*John J. Rizzo*  
ACTING CHIEF BRIDGE ENGINEER


RECOMMENDED AUG. 30, 2019  
*Mark V. Bilek*  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 3 OF 15  
BD-632M

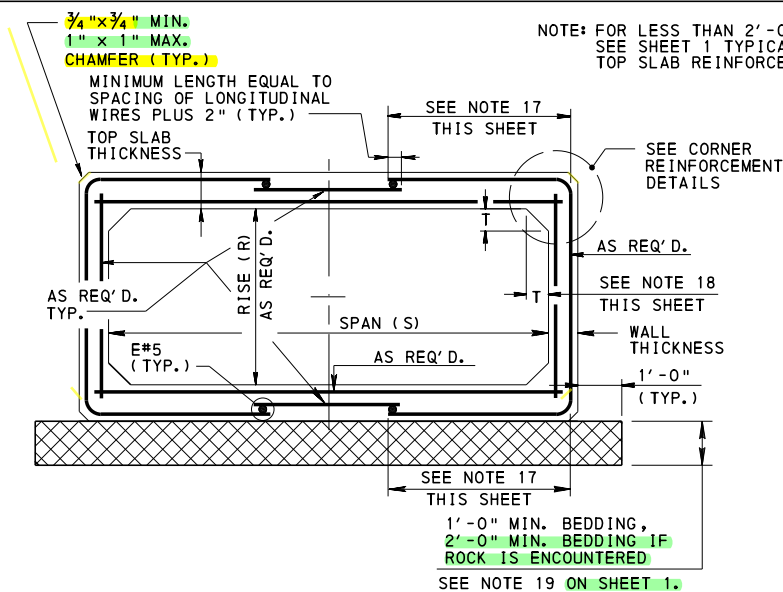


**BOX DETAILS - WELDED WIRE FABRIC**


(FOR 2'-0" OR MORE OF COVER)  
SEE BC-798M FOR POST TENSION STRAND DETAILS

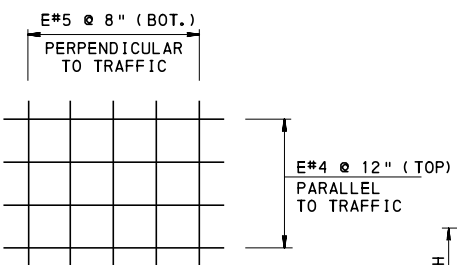

**TYPICAL DECK REINFORCEMENT**

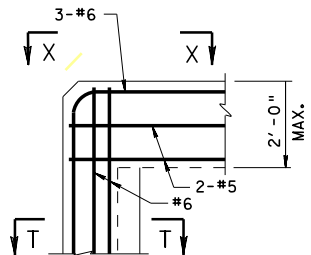

**COLLAR CORNER DETAILS**

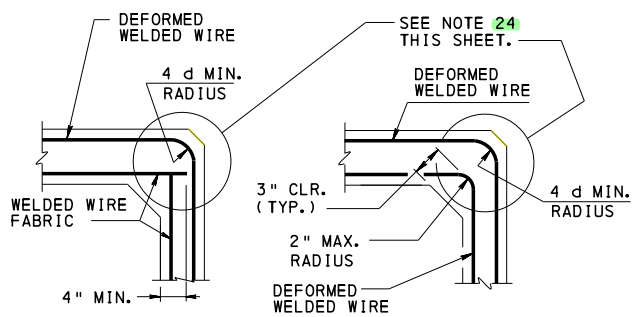



**CORNER REINFORCEMENT DETAILS**

WELDED WIRE FABRIC


**NOTES:**

- FOR LESS THAN 2'-0" OF COVER SEE SHEET 1 TYPICAL BOX SECTION FOR TOP SLAB REINFORCEMENT.
- FOR POST TENSIONING DETAILS, SEE BC-798M.

NOTE: FOR LESS THAN 2'-0" OF COVER SEE SHEET 1 TYPICAL BOX SECTION FOR TOP SLAB REINFORCEMENT.

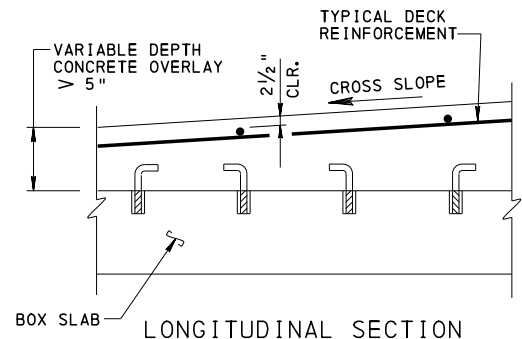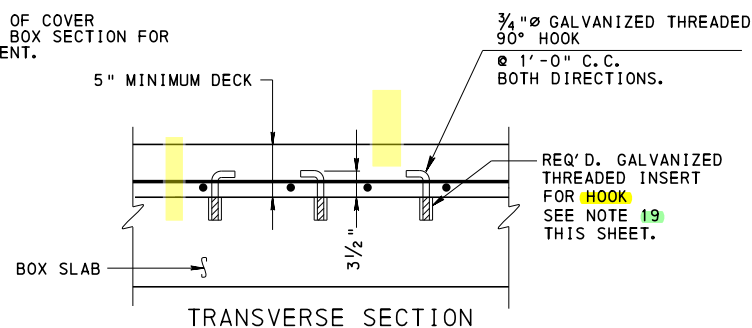

**DECK CONNECTION DETAILS**

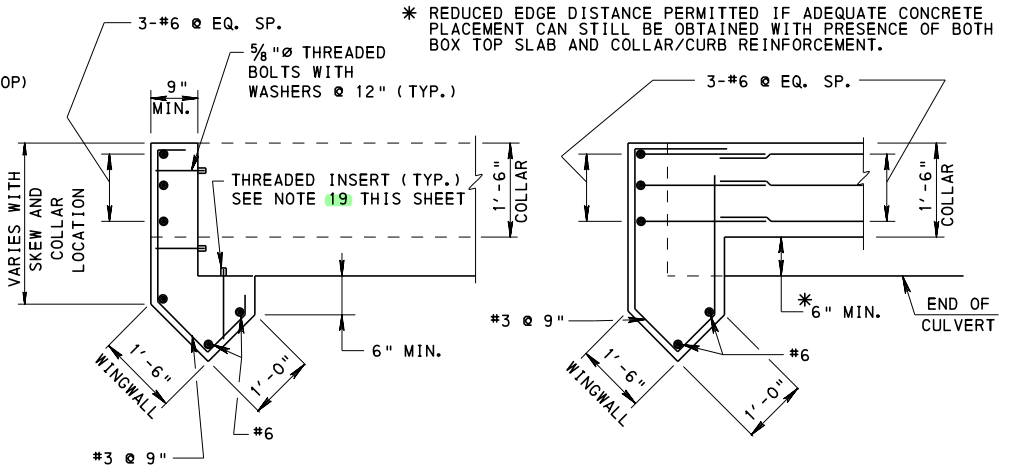

**SECTION T-T**

**SECTION X-X**

**DESIGN DATA:**

- f'c = 5000 P.S.I. MINIMUM FOR CONCRETE
- fy = 60,000 P.S.I. FOR STEEL REINFORCING BARS
- fy = 65,000 P.S.I. FOR WELDED WIRE FABRIC (IN FLAT SHEET)

**INSTRUCTIONS:**

SPAN S	POST TENSIONING DUCT LOCATION	MINIMUM SLAB OR WALL THICKNESS
8' - 12'	HAUNCH	S/12
> 12'	HAUNCH OR WALL	13"

**MINIMUM COVER FOR WELDED WIRE FABRIC :**

- PROVIDE 1 1/2", EXCEPT 2" FOR THE TOP WIRES OF THE TOP SLAB WHERE BOX FILL HEIGHT IS LESS THAN 2'-0".
- USE 1/2" MORE COVER FOR THE TOP WIRES OF THE BOTTOM SLAB.

**MINIMUM COVER FOR CONVENTIONAL REINFORCEMENT BARS:**

PROVIDE 2" FOR THE TOP BARS OF TOP AND BOTTOM SLABS, AND 1 1/2" FOR ALL OTHER BARS, EXCEPT USE 2 1/2" FOR TOP BARS WHEN SLAB IS AT GRADE.

- FOR WELDED WIRE FABRIC, SPACE CIRCUMFERENTIAL WIRES CENTER TO CENTER NOT LESS THAN 2" OR MORE THAN 4", AND SPACE LONGITUDINAL WIRES CENTER TO CENTER NOT MORE THAN 8".

REFER TO SHEET 14 FOR END SECTION SKEW ORIENTATION REQUIREMENTS.

**NOTES**

- PROVIDE GRADE 60 DEFORMED REINFORCING BARS THAT MEET THE REQUIREMENTS OF ASTM A 615, A 996 OR A 706. DO NOT WELD REINFORCEMENT STEEL. DO NOT USE RAIL STEEL (A 996) WHERE BENDING OR WELDING OF REINFORCEMENT BARS IS INDICATED.
- WELDED WIRE FABRIC WILL MEET THE REQUIREMENTS OF AASHTO M55 ASTM (A185), AND DEFORMED WELDED WIRE FABRIC WILL MEET THE REQUIREMENTS OF AASHTO M221 ASTM (A497).
- USE EPOXY COATED REINFORCEMENT AND EPOXY OR GALVANIZED WELDED WIRE FABRIC IN THE FOLLOWING CONDITIONS:
  - IN THE CAST IN PLACE DECK AND HEADWALLS IF A DECK IS USED.
  - IN THE TOP SLAB AND HEADWALL WITHIN 2'-0" OF GRADE IF A CAST IN PLACE DECK IS NOT USED.
  - ALL CURBS AND BARRIERS.
  - THROUGHOUT THE CULVERT WHEN VITRIFIED CLAY LINER PLATES ARE USED.
  - IN ALL CAST-IN-PLACE APRON SLABS (SEE SHEET 1)IF EPOXY COATED WELDED WIRE FABRIC IS USED IT MUST MEET THE REQUIREMENTS OF ASTM A 884, TYPE I, CLASS A.
- DESIGN SPECIFICATIONS: AASHTO LRFD "BRIDGE DESIGN SPECIFICATION" AND AS SUPPLEMENTED BY THE DESIGN MANUAL, PART 4, STRUCTURES.
- PROVIDE MATERIALS AND WORK QUALITY IN ACCORDANCE WITH THE APPROPRIATE SPECIFICATIONS AS OUTLINED IN THE PENNSYLVANIA DEPARTMENT OF TRANSPORTATION PUBLICATION 408.
- DEAD LOADS: INCLUDE A WEIGHT OF 30 P.S.F. FOR FUTURE WEARING SURFACE FOR BOXES AT GRADE.
- PROVIDE MINIMUM LAP AND EMBEDMENT LENGTH OF REINFORCEMENT IN ACCORDANCE WITH LRFD SPECIFICATIONS: SEE BC-736M.
- PROVIDE 2" CONCRETE COVER ON REINFORCEMENT BARS EXCEPT AS NOTED IN INSTRUCTIONS BELOW.
- FOR HYDRAULIC DESIGN REFER TO DESIGN MANUAL, PART 2.
- FOR LOW FLOW FISH PASSAGE DESIGN REFER TO DESIGN MANUAL, PART 2, AND SEE SHEETS 10, 11 AND 13.
- INDICATE ALLOWABLE AND MAXIMUM DESIGN FOUNDATION PRESSURE ON PLANS.
- PLACE HEADWALL AND WINGWALL FOOTINGS BELOW FROST DEPTH OR 3'-6" MINIMUM, WHICH EVER IS GREATER.
- PROVIDE 2'-0" MIN. WIDTH OF WATERPROOFING MEMBRANE AS PER PUB.408, SECTION 680.2(d) OR 680.2(b) ALONG THE TOP AND SIDE JOINTS. FOR ADDITIONAL DETAILS REFER TO BC-788M.
- USE 4" Ø FORMED WEEPHOLES AT EVERY OTHER SEGMENT PLACED AT A MINIMUM 1'-9" ABOVE THE BOTTOM SLAB OR 6" ABOVE NORMAL FLOW LINE. FOR WEEPHOLE PLACEMENT, THE WEEPHOLE LOCATION MAY BE ADJUSTED BY A MAXIMUM OF 2" IN ANY DIRECTION, OR RELOCATE REINFORCEMENT BY A MAXIMUM OF 1/2". DO NOT CUT REINFORCEMENT BARS. NO ADDITIONAL WEEPHOLE REINFORCEMENT WILL BE REQUIRED. IF WIRE MESH IS USED, MAY CUT THE MESH TO FIT WEEPHOLE CONDUIT BUT REPLACE EQUIVALENT STEEL WITH ADDITIONAL WIRE MESH PLACED ON EACH SIDE OF WIRE MESH MAT.
- PRECAST BOX CULVERTS AT GRADE (i.e. ≤ 2'-0" OF FILL) REQUIRE AN ADDITIONAL 5" MINIMUM REINFORCED CONCRETE DECK. THIS 5" DECK WILL BE MAINTAINED FOR ENTIRE BOX CULVERT. REFER TO TYPICAL DECK REINFORCEMENT (THIS SHT.) FOR DETAILS. FOR ADT ≤ 750 AND A.D.T.T. ≤ 25, AN ASPHALT PAVEMENT OVERLAY MAY BE UTILIZED IN LIEU OF A CONCRETE DECK.
- DESIGN PRECAST REINFORCED CONCRETE BOXES TO HAVE OPENINGS IN 6" INCREMENTS WITH MINIMUM RISE OF 3'-0".
- REQUIRED DIMENSION FOR BAR LENGTH IS THE TOTAL OF THE THEORETICAL CUT-OFF LENGTH PLUS THE REQUIRED ANCHORAGE.
- HAUNCH SIZE SHOWN (T) IS BASED ON AASHTO M273. HAUNCH MAY BE MODIFIED IF THE BOX IS CUSTOM DESIGNED TO SATISFY DESIGN, TRANSPORTATION AND CONSTRUCTION REQUIREMENTS, BUT NOT LESS THAN 6" x 6".
- THREADED INSERTS TO BE INCORPORATED IN PRECAST BOX AND DETAILED BY THE FABRICATOR.
- CONCRETE HEADWALL REINFORCEMENT WILL REQUIRE A SEPARATE DESIGN IF HEIGHT IS GREATER THAN 2'-0".
- IF APPROACH ROADWAY UTILIZES CURB, ADJUST DIMENSION TO MATCH CURB HEIGHT.
- USE EPOXY BONDING COMPOUND WHERE EVER CAST-IN-PLACE CEMENT CONCRETE COMES IN CONTACT WITH PRECAST CEMENT CONCRETE. THE EPOXY BONDING COMPOUND IS TYPE 2, GRADE 2, AS DESCRIBED IN ASTM-C881-90.
- THE USE OF PRECAST END SECTION IS NOT PRECLUDED BUT WILL BE REVIEWED ON AN INDIVIDUAL BASIS BY THE DISTRICT BRIDGE ENGINEER. HAUNCH SIZE MUST MATCH THAT OF BOX CULVERT SEGMENTS.
- POST-TENSIONING DUCTS MAY BE PLACED AT EITHER CORNER OR HAUNCH TO SATISFY DESIGN AND CONSTRUCTION REQUIREMENTS. PROVIDE A 3" CONCRETE CLEARANCE. HAUNCH DUCT MUST BE SECURED TO INSIDE FACE REINFORCEMENT, SEE SHEETS 7 AND 9.
- FOR DECK CONNECTION DETAIL FOR VARIABLE DEPTH CONCRETE DECKS, THE DECK REINFORCEMENT WILL BE INDEPENDENT OF ANCHOR BOLT AND MUST MAINTAIN CLEARANCE AND FOLLOW CROSS SLOPE.
- SEE NOTE 20 ON SHEET 1 FOR BACKFILL REQUIREMENTS AT INLET END OF CULVERT AND NOTE 11 ON SHEET 1 FOR TREATMENT OF WEEP HOLES IN BACKFILL AREAS AT INLET END OF CULVERT.
- SPECIFY 4'-0" MINIMUM SEGMENT LENGTH ON THE CONTRACT DRAWINGS.
- FOR SKEWED SEGMENTS, A SQUARED (NORMAL) CONNECTION IS AN ACCEPTABLE OPTION DURING PHASE CONSTRUCTION.
- CLASS A, TYPE 4 GEOTEXTILE IS PERMITTED TO BE PLACED BETWEEN THE BEDDING MATERIAL AND EXCAVATION OR TO ENCASE THE BEDDING MATERIAL.

**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
BUREAU OF PROJECT DELIVERY


**STANDARD**  
**R.C. BOX CULVERT**  
**PRECAST**

RECOMMENDED AUG. 30, 2019  
*James J. Ringer*  
ACTING CHIEF BRIDGE ENGINEER

RECOMMENDED AUG. 30, 2019  
*Michael J. B. B. B.*  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 4 OF 15  
**BD-632M**



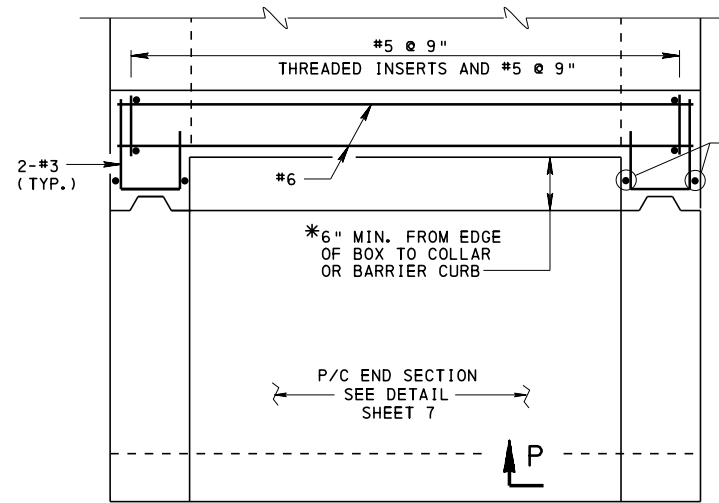

PLAN  
PRECAST END SECTION


\* REDUCED EDGE DISTANCE PERMITTED IF ADEQUATE CONCRETE PLACEMENT CAN STILL BE OBTAINED WITH PRESENCE OF BOTH BOX TOP SLAB AND COLLAR/CURB REINFORCEMENT.

THREADED INSERT LOCATIONS (TYP.)

\*6" MIN. FROM EDGE OF BOX TO COLLAR OR BARRIER CURB


P/C END SECTION  
SEE DETAIL SHEET 7

P

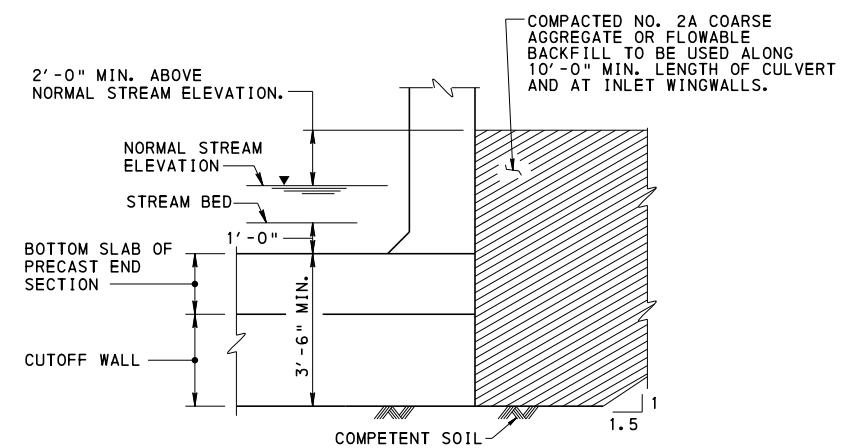


SECTION P-P

NOTE:  
DESIGNER TO MODIFY AMOUNT OF COMPACTED NO. 2A COARSE AGGREGATE OR FLOWABLE BACKFILL TO PROVIDE ADEQUATE PROTECTION AGAINST PIPING OF STREAM FLOW THROUGH FILL AT INLET END OF CULVERT.

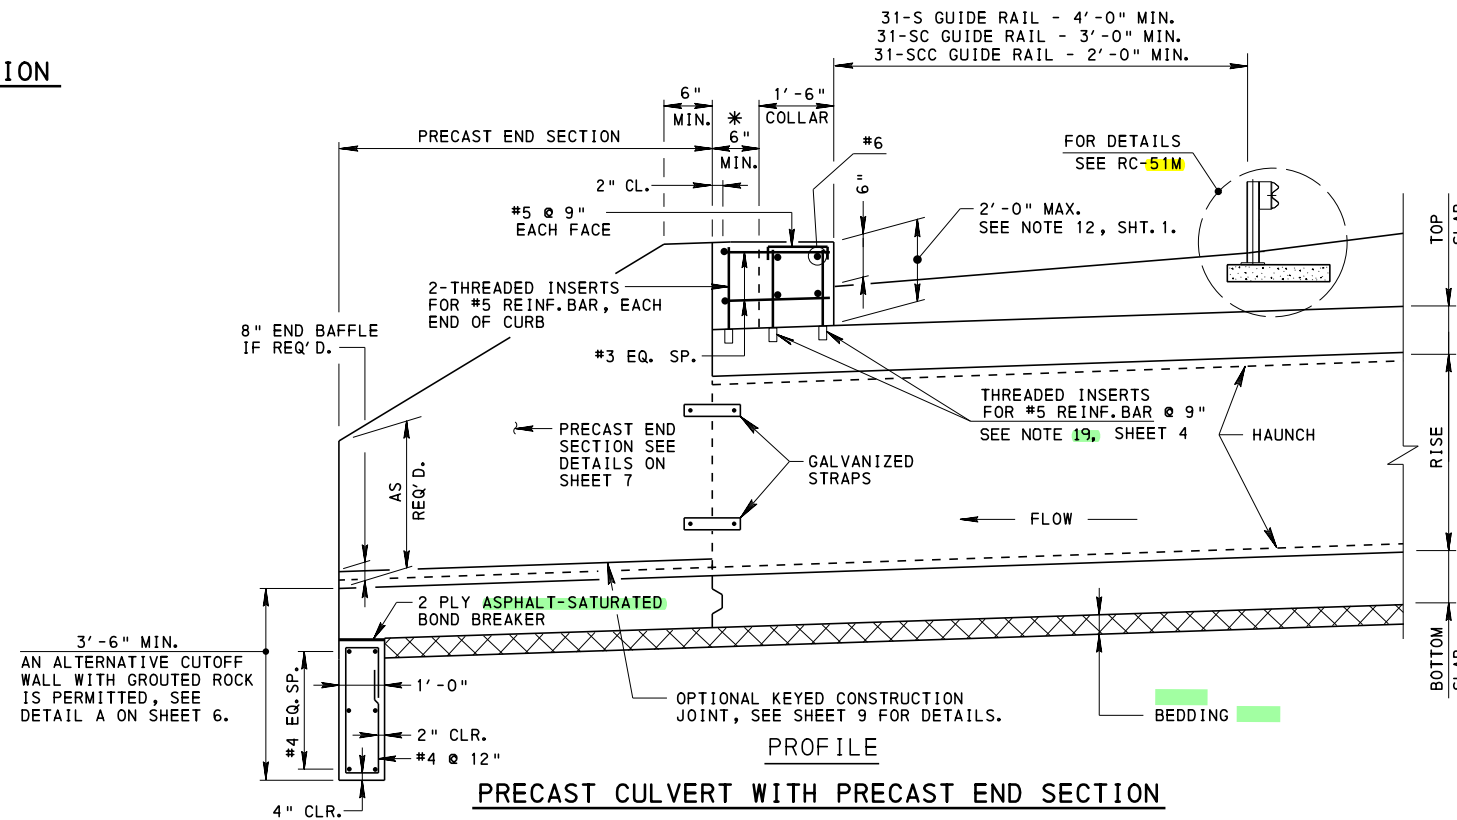


- NOTES:
- SEE NOTE 23, SHEET 4.
  - FOR ROCK PROTECTION SEE "CULVERT WITH CAST IN PLACE WINGWALLS" DETAIL, ON SHT. 6.
  - FOR PRECAST END SECTION CONNECTION SEE BC-798M FOR GALVANIZED STRAP CONNECTION DETAIL.
  - POST TENSION BOTTOM SLAB OF END SECTION PRIOR TO INSTALLATION OF CUTOFF WALL.

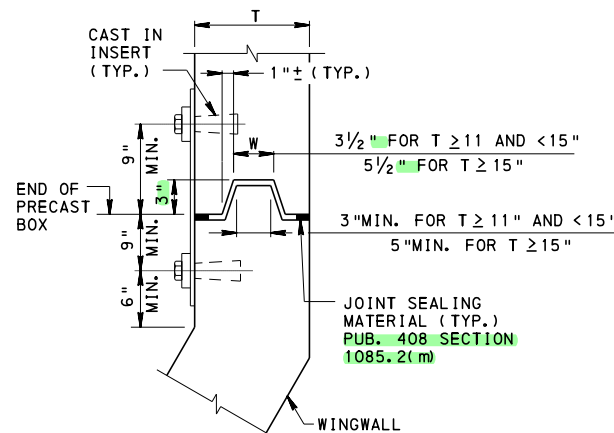

PARTIAL PLAN

KEYED JOINT


DISCONTINUOUS IF POST TENSIONING IS REQUIRED

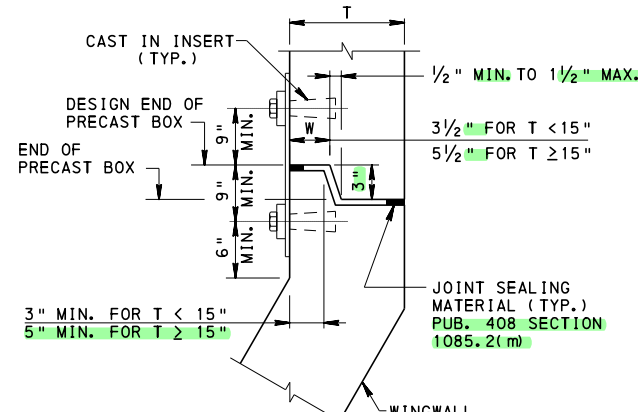

PARTIAL PLAN

SHIP LAP JOINT

DISCONTINUOUS IF POST TENSIONING IS REQUIRED

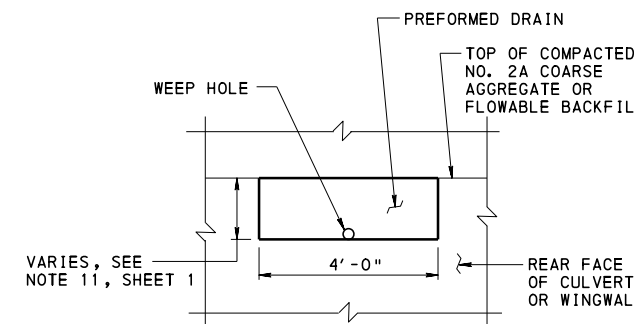

PREFORMED DRAIN DETAIL

COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R. C. BOX CULVERT  
PRECAST

RECOMMENDED AUG. 30, 2019  
ACTING CHIEF BRIDGE ENGINEER


RECOMMENDED AUG. 30, 2019  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 5 OF 15  
BD-632M

- NOTES:
1. NO BOLT THROUGH CONNECTIONS CAN BE USED.
  2. EITHER SHIP LAP OR KEYWAY JOINTS CAN BE USED. NO FLUSH BUTT JOINTS.
  3. ONE (1) ROW OF JOINT SEALING FLEXIBLE FOAM MATERIAL EACH FACE.
  4. FOR T < 11", USE SHIP LAP DETAIL.

\* REDUCED EDGE DISTANCE PERMITTED IF ADEQUATE CONCRETE PLACEMENT CAN STILL BE OBTAINED WITH PRESENCE OF BOTH BOX TOP SLAB AND COLLAR/CURB REINFORCEMENT.


AN ALTERNATIVE CUTOFF WALL WITH GROUTED ROCK IS PERMITTED, SEE DETAIL B THIS SHEET.

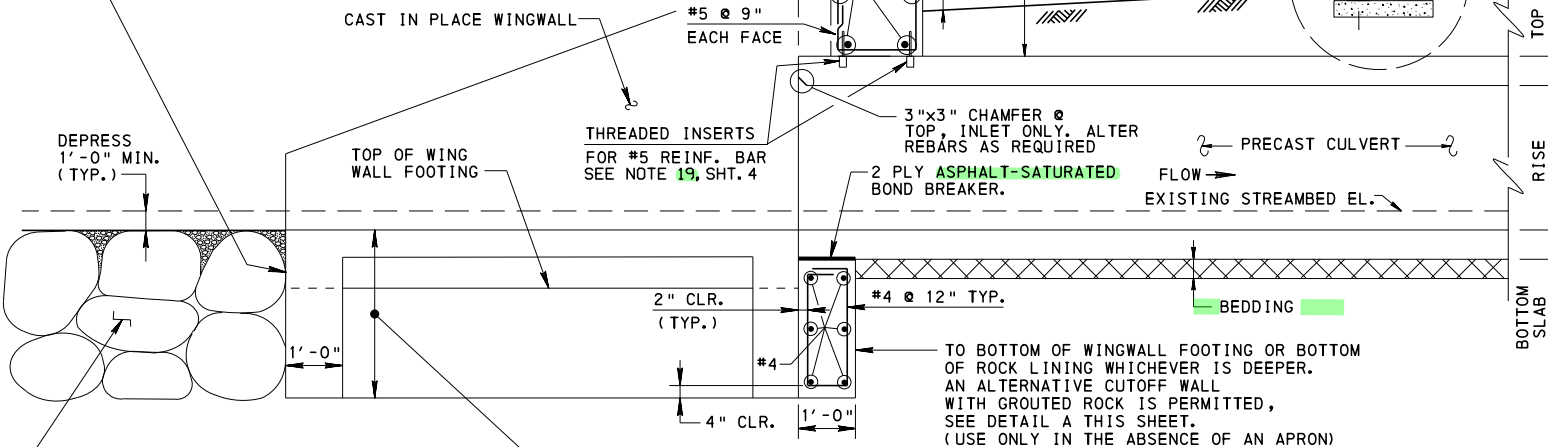


MIN. R-6 ROCK LINING (PUB. 408, SECTION 850) INLET AND OUTLET, 5'-0" LENGTH FROM END OF CULVERT OR APRON. TOP OF ROCK LINING SHOULD BE 1'-0" BELOW STREAMBED AND CHOKED WITH STREAMBED MATERIAL. IF BAFFLES ARE USED, THE STREAMBED MATERIAL SHOULD BE PLACED ON TOP OF THE ROCK LINING TO A MAXIMUM HEIGHT OF THE TOP OF THE BAFFLE TO THE LIMIT OF THE ROCK LINING.

1'-0" CUTOFF WALL TYP. EACH END TO BOTTOM OF WINGWALL FOOTING OR BOTTOM OF ROCK LINING WHICHEVER IS DEEPER 3'-6" MIN. (SEE NOTE 12 ON SHEET 4).

PROFILE

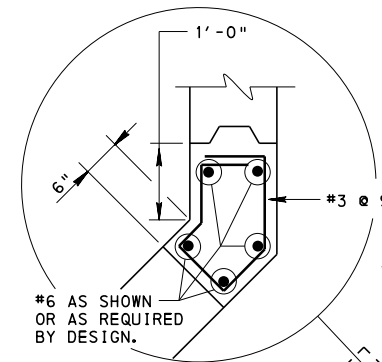


#6 AS SHOWN OR AS REQUIRED BY DESIGN.

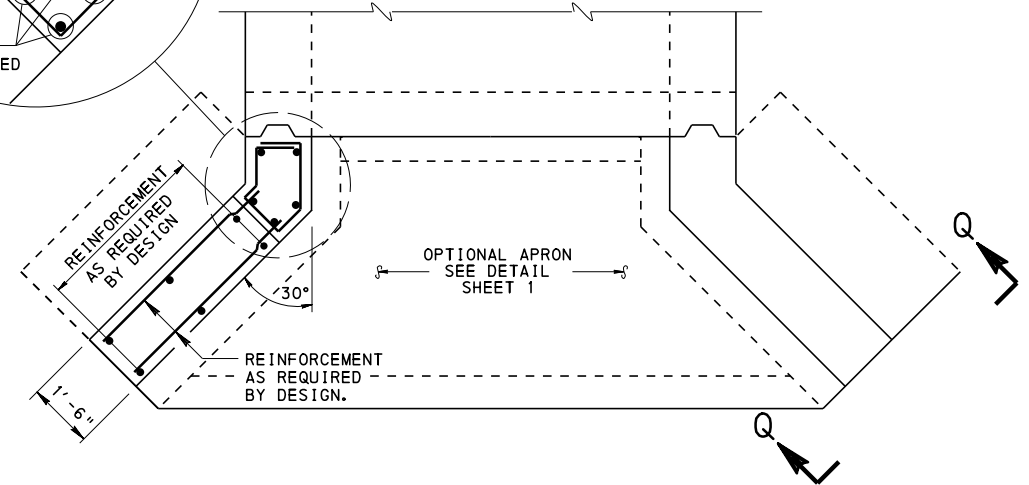

PLAN

(COLLAR OR BARRIER CURB NOT SHOWN)


### PRECAST CULVERT WITH CAST-IN-PLACE WINGWALLS

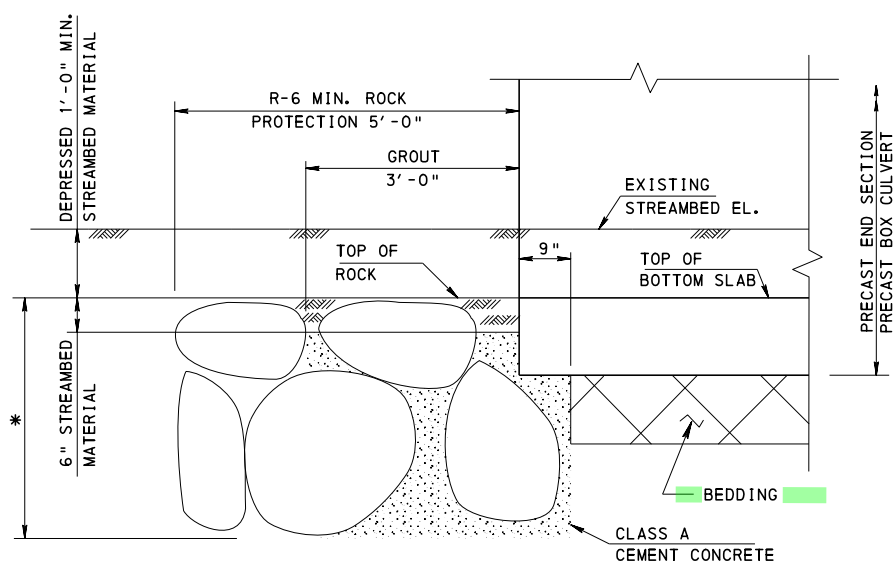


DETAIL A (WITHOUT APRON)

\* TO BOTTOM OF WINGWALL FOOTING OR BOTTOM OF ROCK LINING WHICH EVER IS DEEPER (3'-6" MIN.). FILL VOIDS IN ROCK WITH VIBRATED CLASS A CEMENT CONCRETE 6" BELOW STREAMBED TO BOTTOM OF ROCK. FILL TOP 6" OF ROCK WITH NATURAL STREAMBED MATERIAL

### ALTERNATIVE CUTOFF WALL WITH GROUTED ROCK

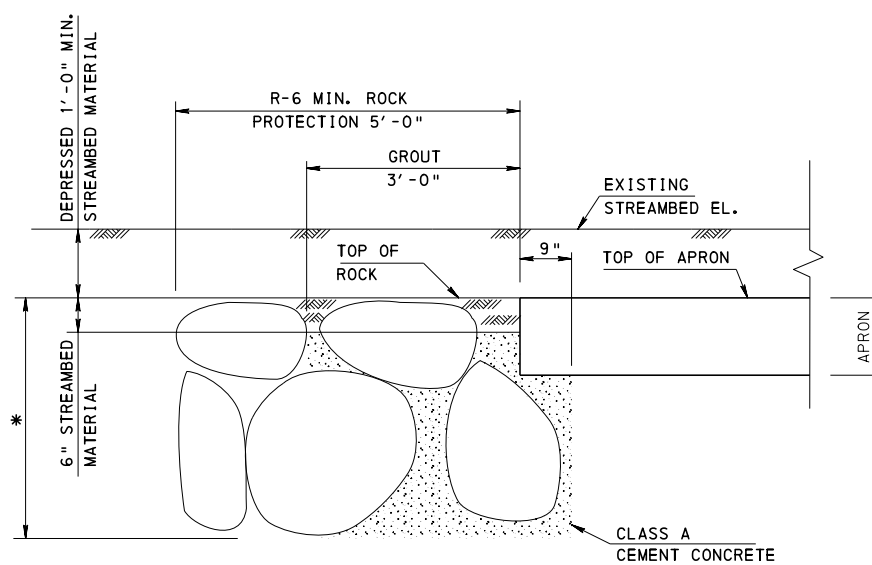

DETAIL B (WITH APRON)

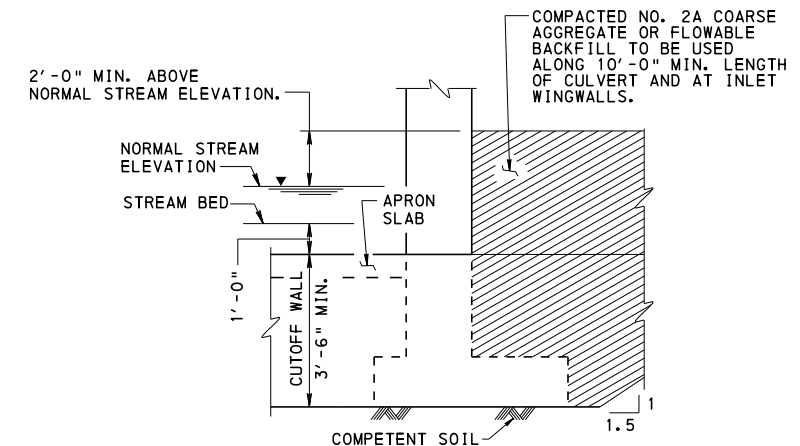

SECTION Q-Q

NOTE: DESIGNER TO MODIFY AMOUNT OF COMPACTED NO. 2A COARSE AGGREGATE OR FLOWABLE BACKFILL TO PROVIDE ADEQUATE PROTECTION AGAINST PIPING OF STREAM FLOW THROUGH FILL AT INLET END OF CULVERT.


COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R. C. BOX CULVERT  
PRECAST


RECOMMENDED AUG. 30, 2019  
*James J. Ringer*  
ACTING CHIEF BRIDGE ENGINEER

RECOMMENDED AUG. 30, 2019  
*Michael J. Biele*  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 6 OF 15  
BD-632M

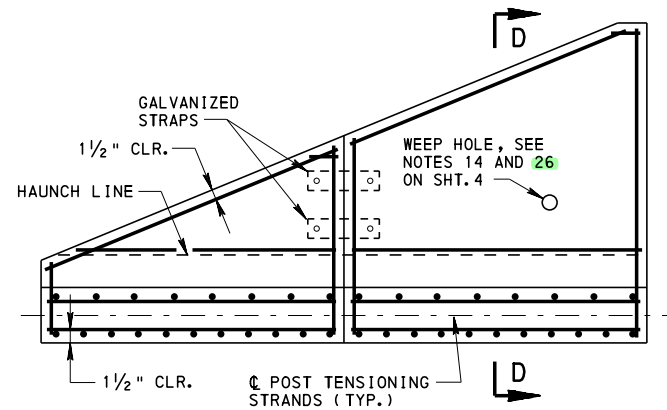


POST-TENSION END SECTION  
SPAN > 12 FEET

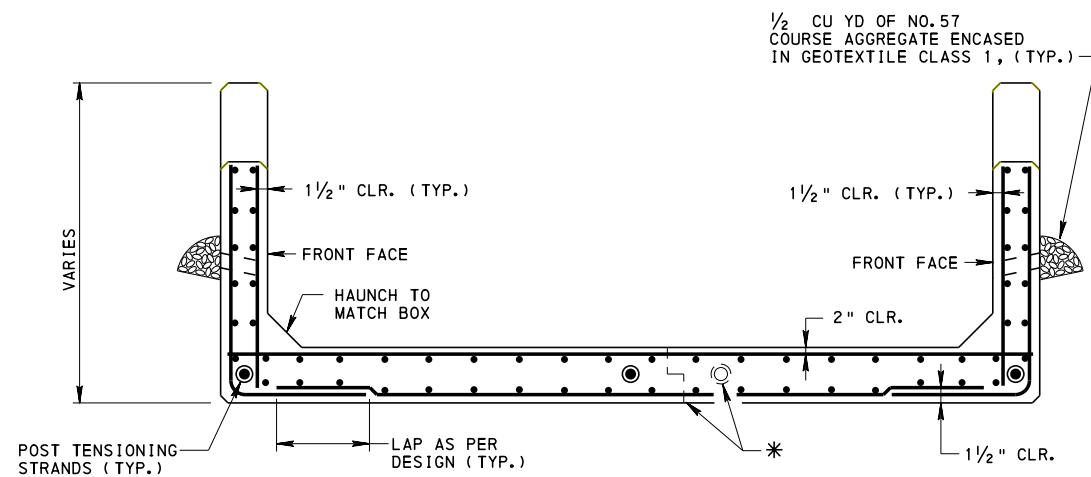


SECTION D-D

\* SPECIFY JOINT AND ADDITIONAL END SECTION POST TENSION STRAND IF WIDTH IS RESTRICTED DUE TO SHIPPING RESTRAINTS.

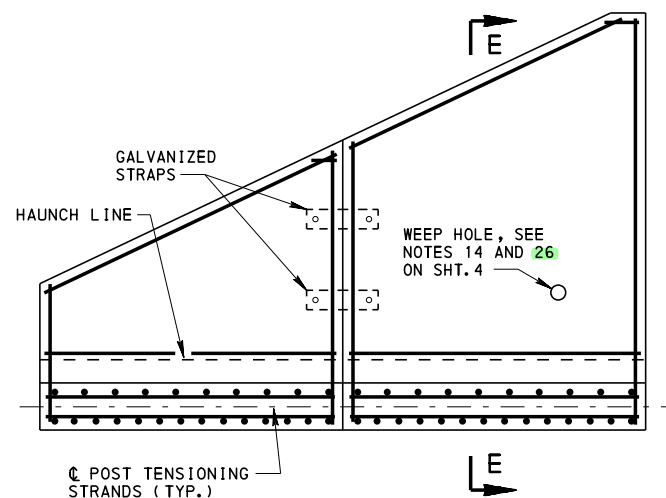

POST-TENSION END SECTION  
SPAN ≤ 12 FEET

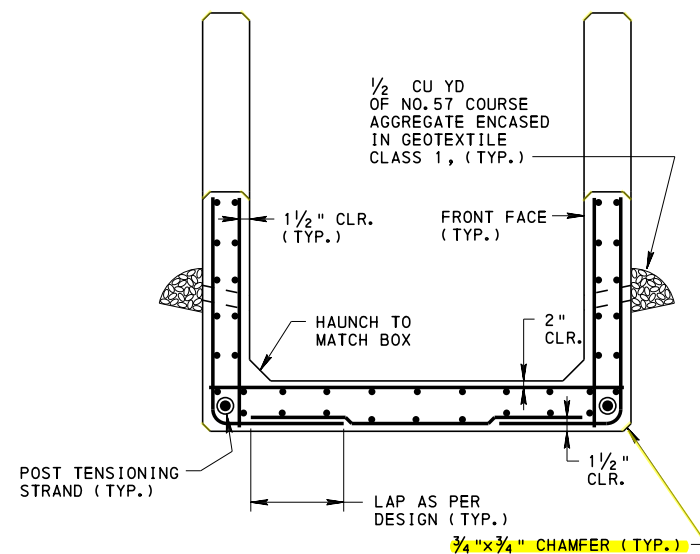


SECTION E-E

#### GENERAL NOTES:

1. EPOXY COAT REINFORCEMENT AS PER R.C. BOX CULVERT DESIGN.
2. REBAR SHOWN IS FOR ORIENTATION ONLY, REBAR SIZE AND SPACING AS PER DESIGN.
3. WALL REINFORCEMENT CAN BE ADJUSTED TO ACCOMMODATE WEEPHOLE. DO NOT CUT REINFORCEMENT.
4. CAST-IN-PLACE CONCRETE IS PERMITTED IN ANY PORTION OF THE PRECAST END SECTIONS, ONLY IF HEIGHT OR WIDTH OF END SECTIONS ARE RESTRICTED DUE TO SHIPPING RESTRAINTS.

#### POST-TENSIONING NOTES:

1. EXTEND BOTTOM ROW OF POST-TENSIONING STRANDS THROUGH THE BOTTOM SLAB OF PRECAST CONCRETE INLET AND OUTLET END SECTIONS.
2. BOX SEGMENTS AND END SECTIONS ARE POST-TENSIONED IN STAGES. THE CONTRACTOR IS REQUIRED TO SUBMIT A PLAN FOR POST-TENSIONING SEQUENCE TO THE DEPARTMENT FOR APPROVAL PRIOR TO SETTING ANY SEGMENTS.
3. POST-TENSION BOX SEGMENTS FIRST, THEN PROVIDE:
  - MECHANICAL SPLICERS ON BOTTOM STRANDS TO CONNECT WITH THE INLET/OUTLET END SECTIONS AND POST-TENSION BOTTOM STRANDS THROUGH THE END SECTIONS.
  - STRAPS ON SIDES OF END SECTION AS SHOWN ON BC-798M.
4. PROVIDE FULL CONTACT OF THE JOINT SEALING MATERIAL AROUND THE ENTIRE JOINT BETWEEN THE END SECTIONS AND THE BOX SECTIONS.
5. AFTER POST-TENSIONING IS APPROVED, CUT STRANDS TO PROVIDE A MINIMUM OF 2 1/2" CLEAR FROM OUTSIDE FACE OF CONCRETE AND COAT RECESS WITH EPOXY BONDING COMPOUND AND FILL WITH NON-SHRINK GROUT.
6. THE NUMBER OF POST-TENSIONING STRANDS MAY BE INCREASED AND THEIR LOCATIONS MAY BE ADJUSTED BY THE FABRICATOR.
7. PRECAST CONCRETE SEGMENT LENGTH TO BE DETERMINED BY THE FABRICATOR.
8. STAGING, SPACING AND POST-TENSION FORCE TO BE SHOWN ON FABRICATOR'S SHOP DRAWINGS.
9. SEE BC-798M, SHEET 1 FOR ADDITIONAL POST-TENSIONING NOTES.

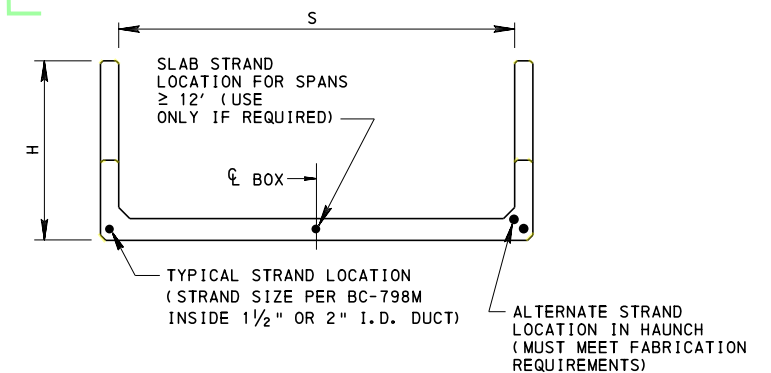

TYP. BOX END SECTION  
SHOWING STRAND LOCATIONS



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R.C. BOX CULVERT  
PRECAST  
POST-TENSIONED END SECTIONS



RECOMMENDED AUG. 30, 2019  
*John J. Rizzo*  
ACTING CHIEF BRIDGE ENGINEER

RECOMMENDED AUG. 30, 2019  
*Mark V. Bilek*  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 7 OF 15  
BD-632M

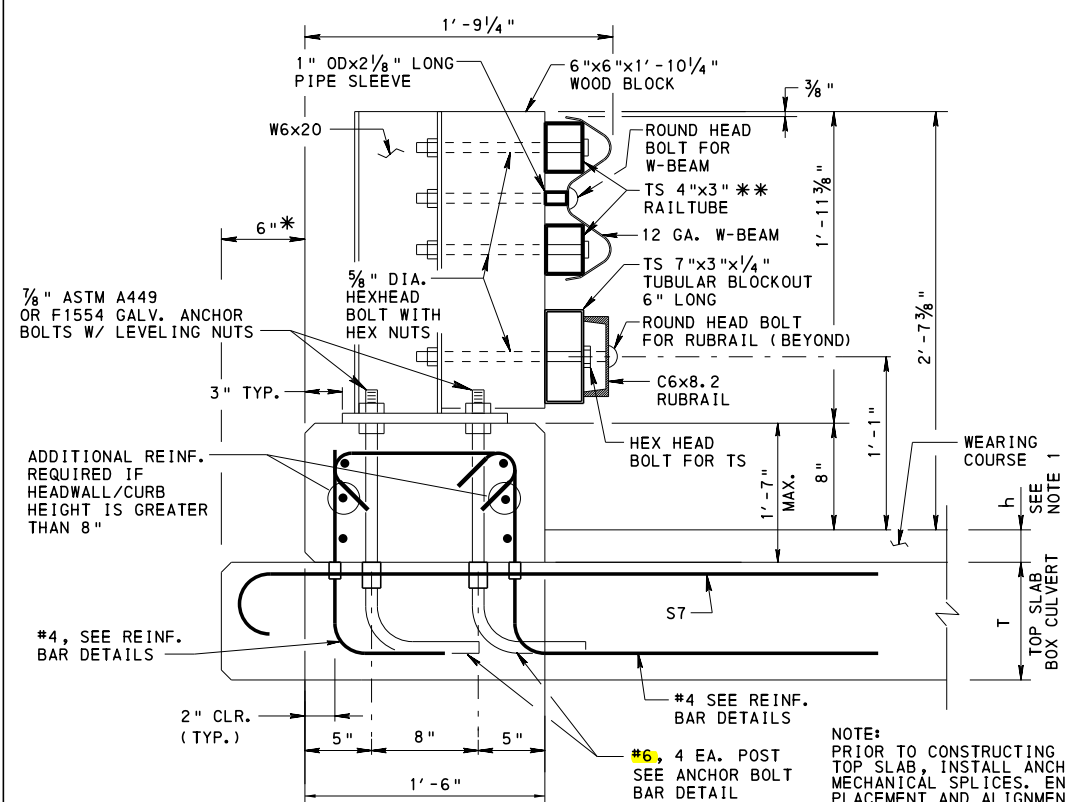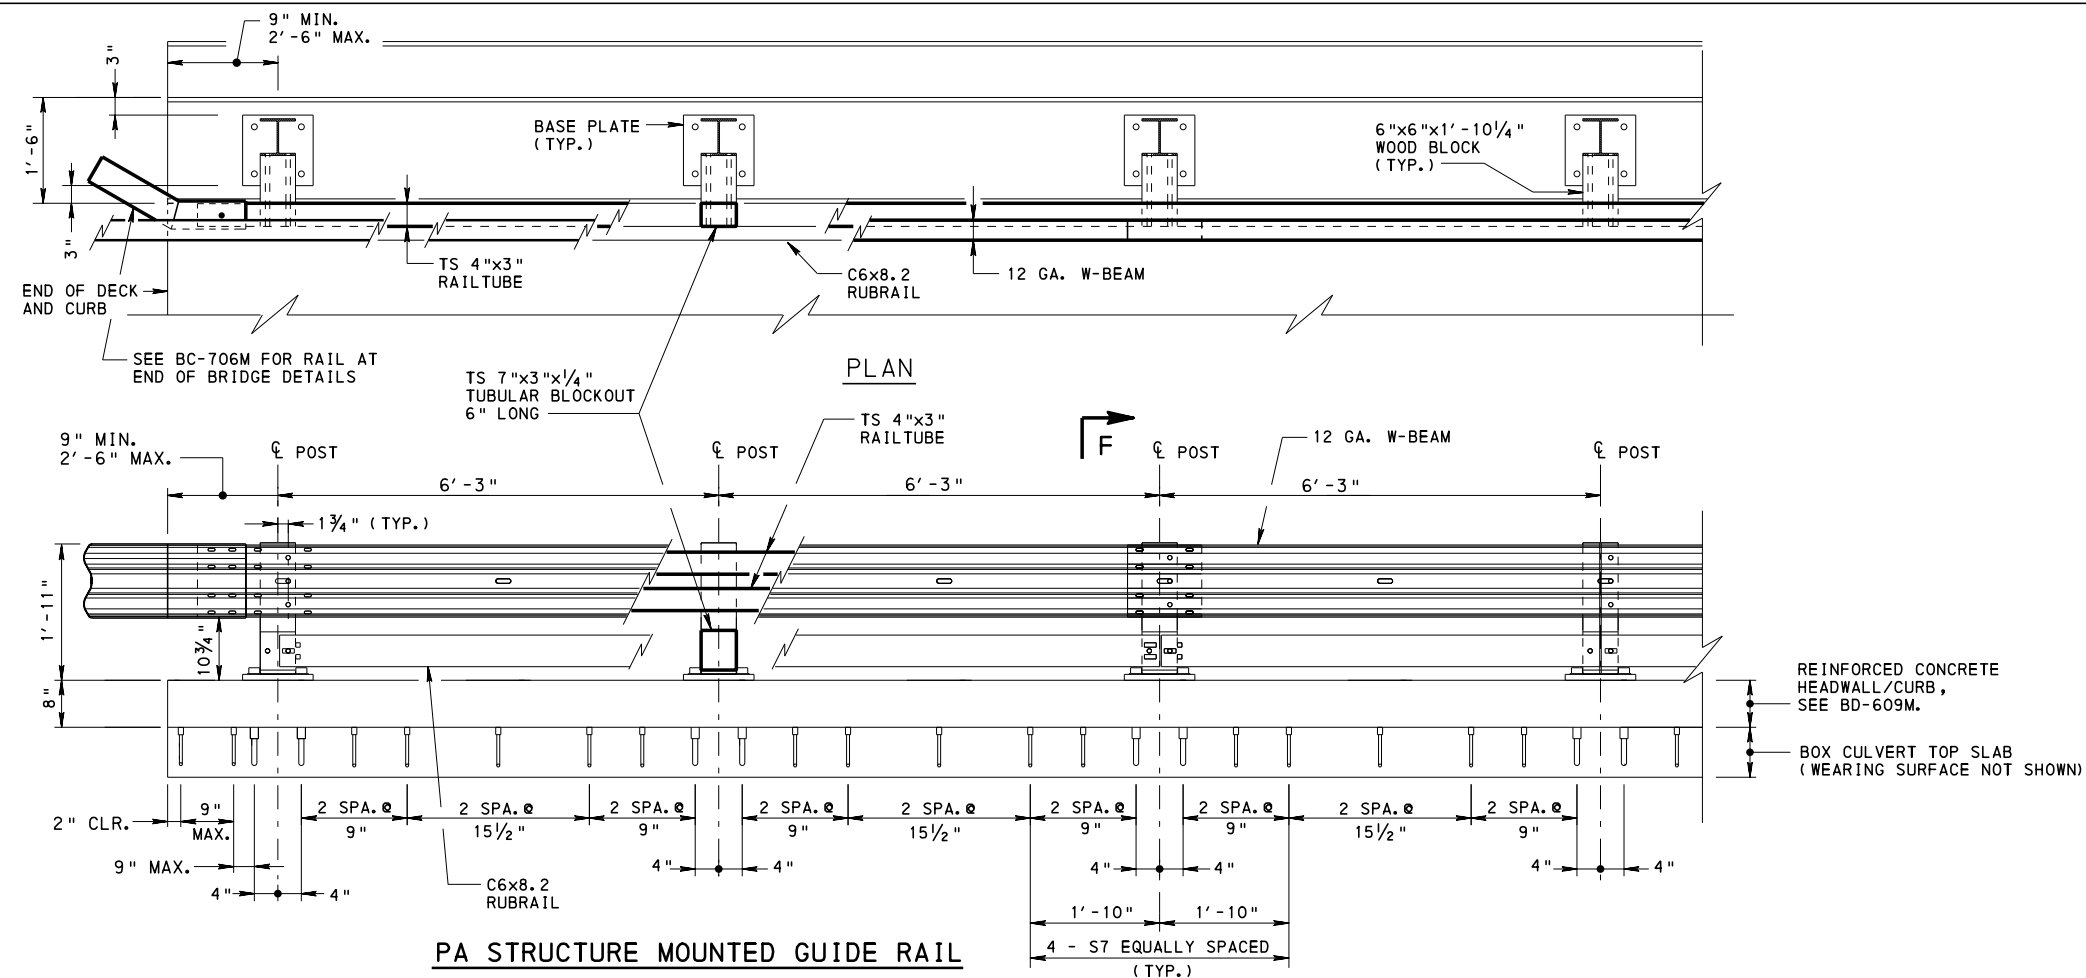

- CURB REINFORCEMENT SHOWN FOR CLARITY, SEE BD-609M.
- SEE RC-51M FOR TYPE 31 STRONG POST GUIDE RAIL DETAILS
- S7 REINFORCEMENT REQUIRED AT POST LOCATIONS ONLY.  
SEE SLAB REINFORCEMENT BAR DETAILS THIS SHEET.

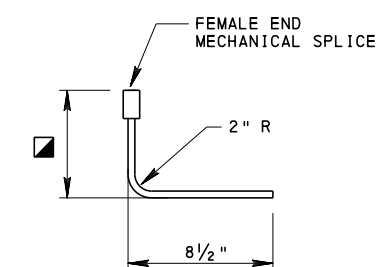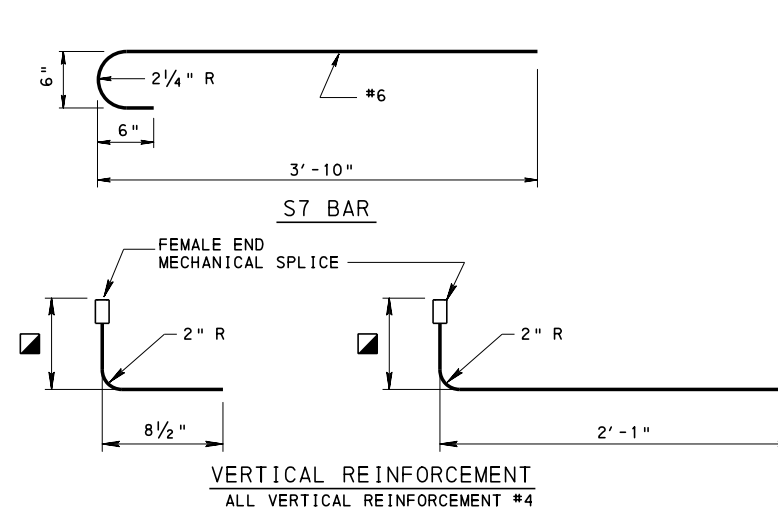

### LEGEND

- FOR  $T < 10$ " :  $T-2$ "  
 FOR  $T \geq 10$ " : 8" MIN.  
 (T=TOP SLAB THICKNESS OF BOX CULVERT)
- \* REDUCED EDGE DISTANCE PERMITTED IF ADEQUATE CONCRETE PLACEMENT CAN STILL BE OBTAINED WITH PRESENCE OF BOTH BOX TOP SLAB AND CURB REINFORCEMENT.
  - \*\* FOR TUBE THICKNESS SEE TUBE RAIL SPECIFICATIONS TABLE ON BC-706M.

NOTE:

1. 2 1/2" MIN., 11" MAX. TOTAL WEARING COURSE THICKNESS (h) (COMBINATION OF FILL OR 5" MIN. REINF. CONC. DECK AND OVERLAY)

COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R. C. BOX CULVERT  
HEADWALL DETAILS  
PRECAST

RECOMMENDED AUG. 30, 2019  
*Don J. R...*  
 ACTING CHIEF BRIDGE ENGINEER








RECOMMENDED AUG. 30, 2019  
*Melvin V. Butler*  
 ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 8 OF 15

---

BD-632M



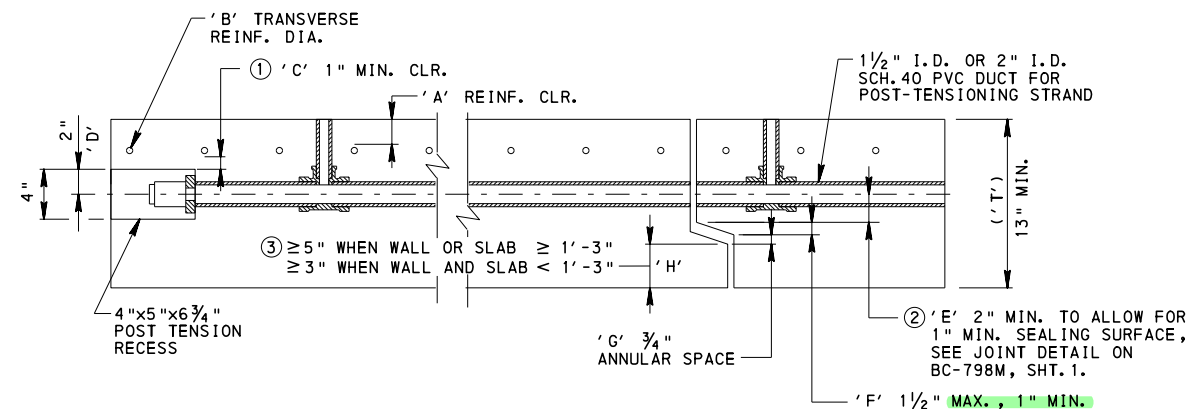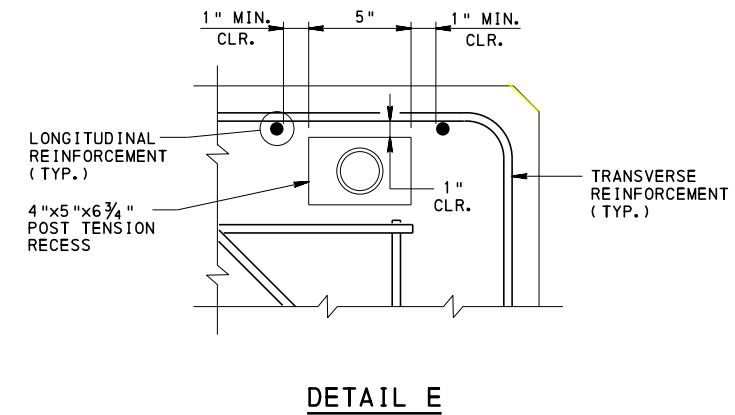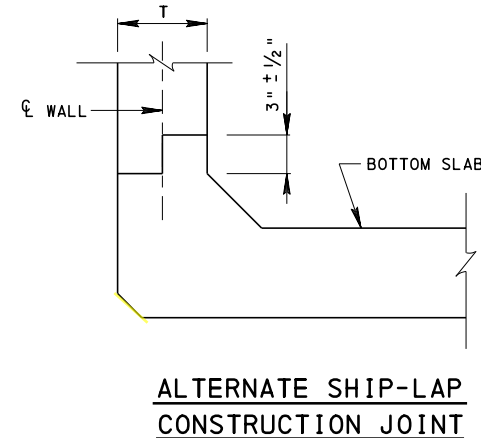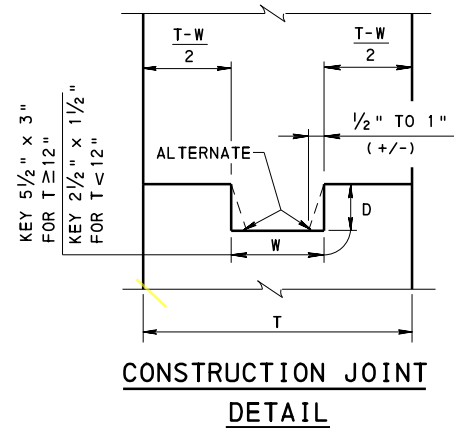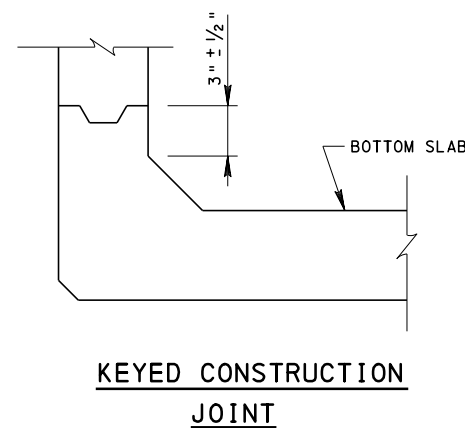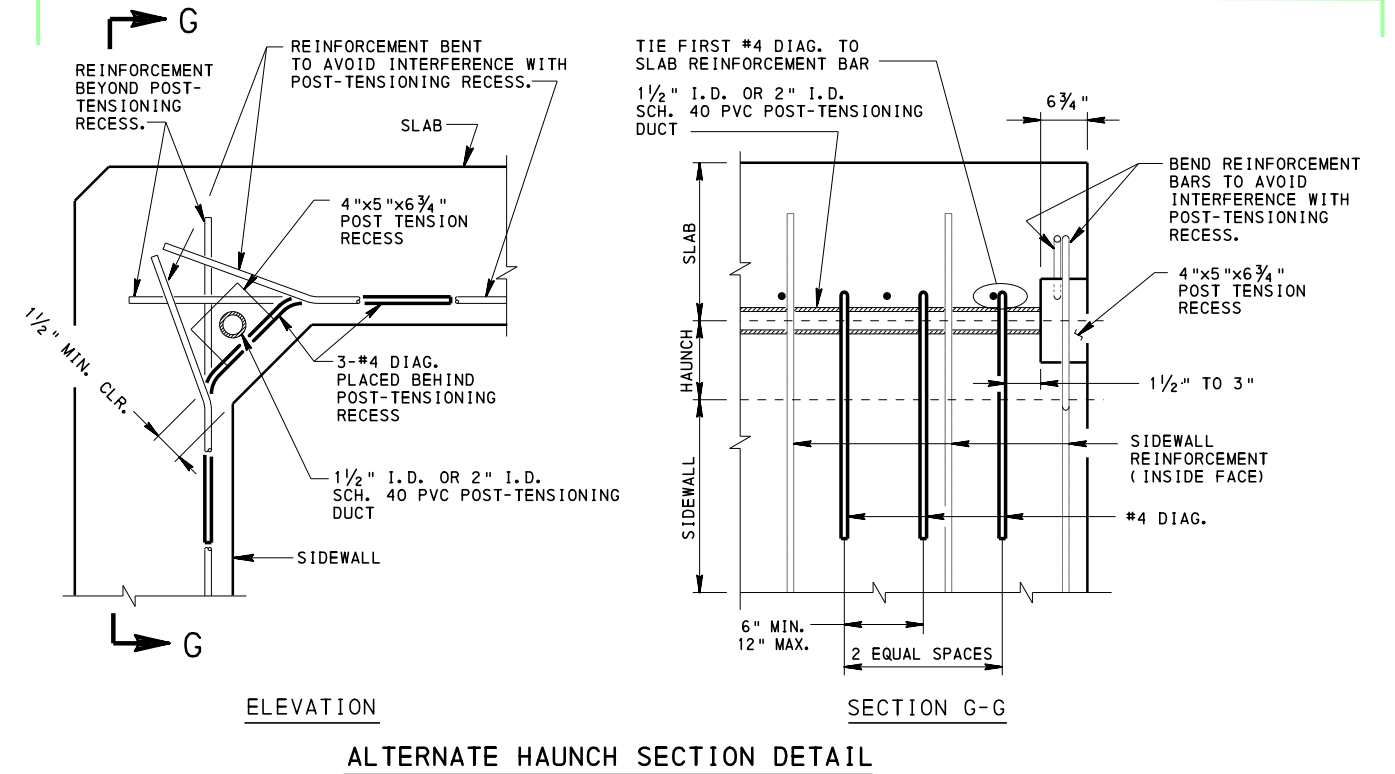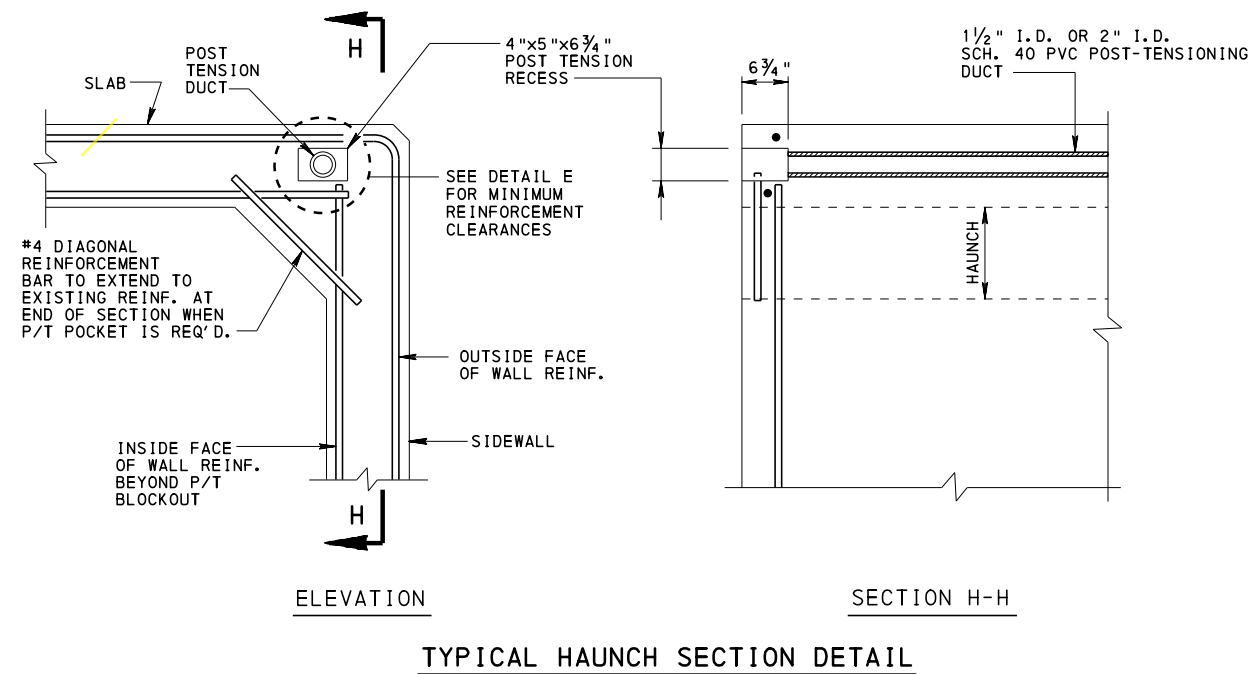





# **CONFIGURATION FOR SLAB/WALL WITH POST-TENSIONING**

MIN. SLAB/WALL THICKNESS ('T') DETERMINED TO ENSURE THE MIN. REQUIREMENTS ①②③ ARE MET.

MIN. SLAB/WALL THICKNESS:  
T = A + B + C + D + E + F + G + H


NOTE: PLACE POST-TENSIONING DUCTS ONLY IN CORNER HAUNCHES WHEN WALL THICKNESSES ARE < 13".

<p><b>COMMONWEALTH OF PENNSYLVANIA</b>  <b>DEPARTMENT OF TRANSPORTATION</b>          BUREAU OF PROJECT DELIVERY</p>		
<p><b>STANDARD</b>  <b>R. C. BOX CULVERT</b>  <b>MISCELLANEOUS DETAILS</b>  <b>PRECAST</b></p>		
<p>RECOMMENDED AUG. 30, 2019  <i>John J. Rizzo</i>          ACTING CHIEF BRIDGE ENGINEER</p>	<p>RECOMMENDED AUG. 30, 2019  <i>Mark V. Bate</i>          ACT. DIR., BUR. OF PROJECT DELIVERY</p>	<p>SHEET 9 OF 15  <b>BD-632M</b></p>

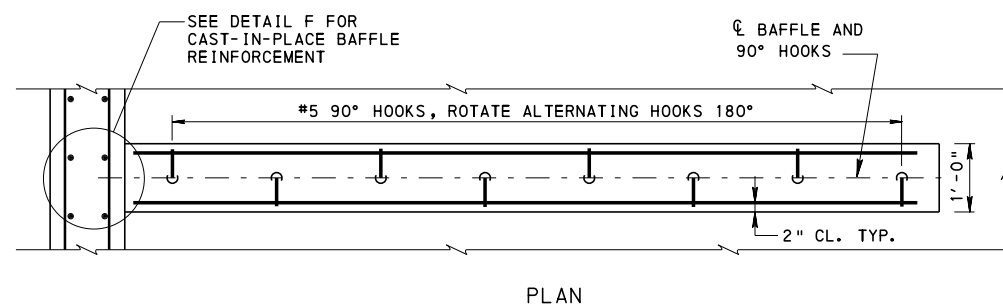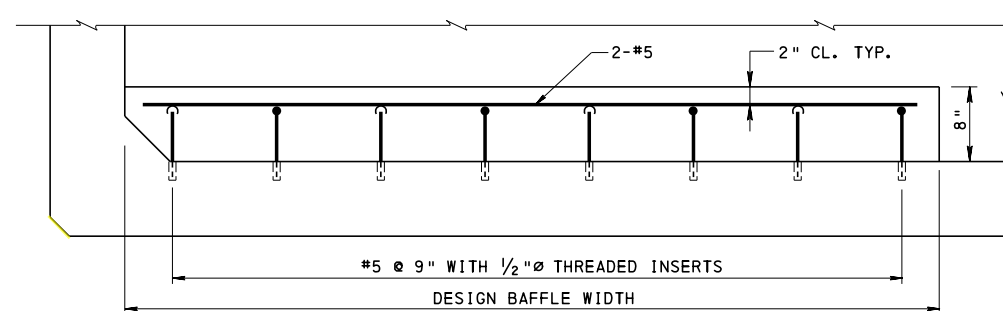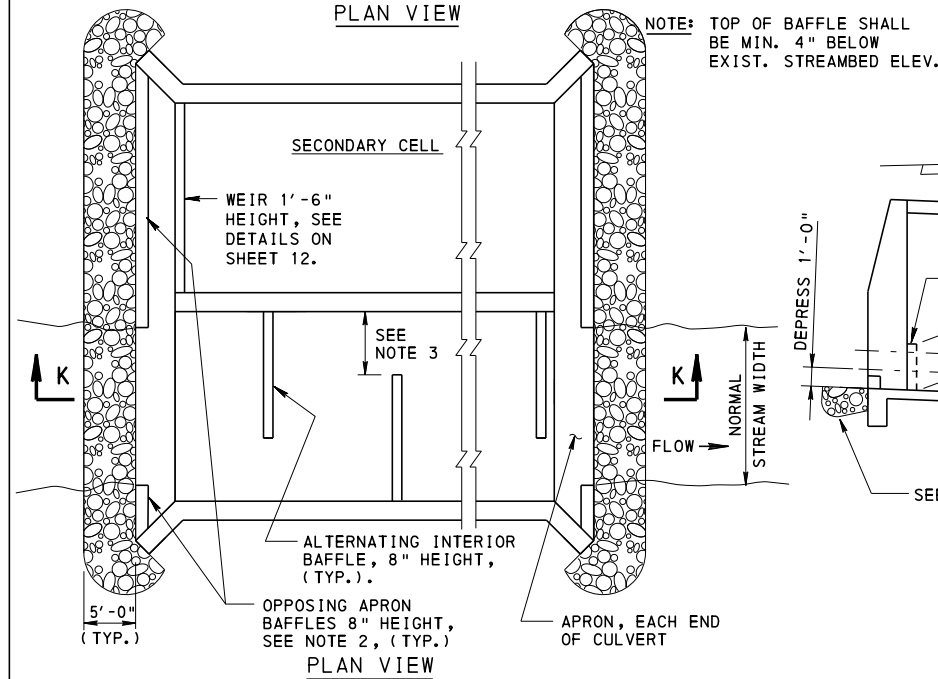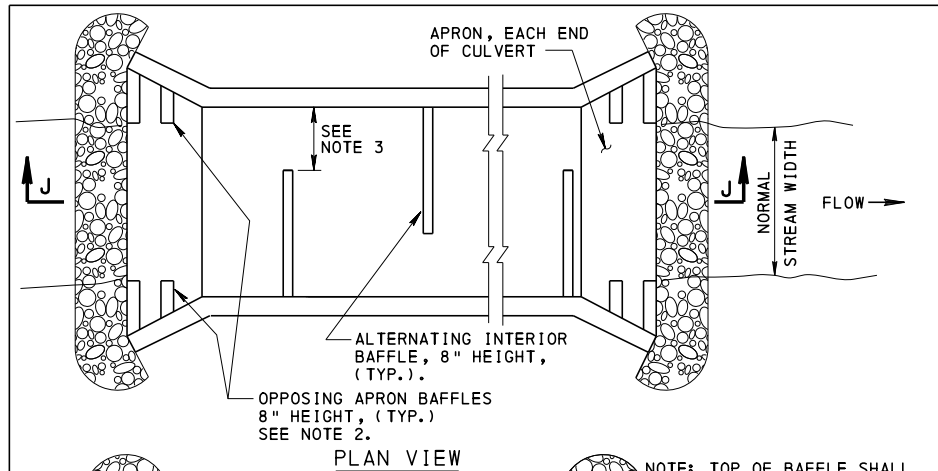


**TYPICAL BAFFLE**




PRECAST REINFORCEMENT SHOWN, CAST-IN-PLACE REINFORCEMENT SIMILAR EXCEPT AS NOTED ON THIS STANDARD.

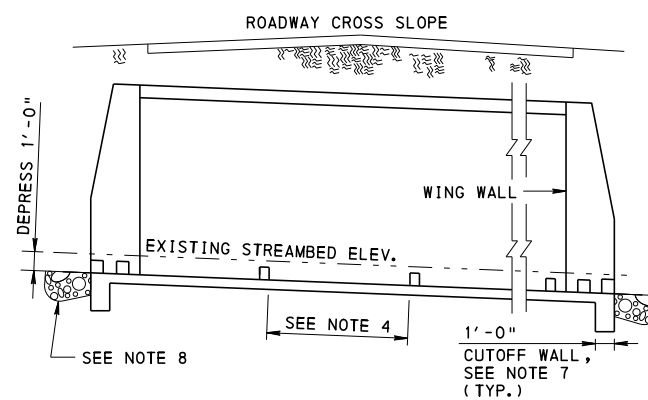

## BOX CULVERTS

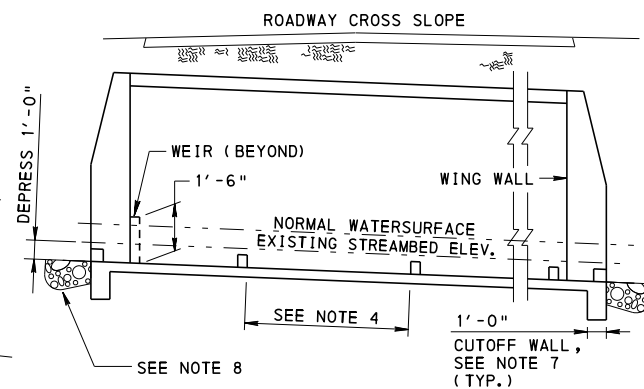


## TWIN CELL BOX CULVERTS

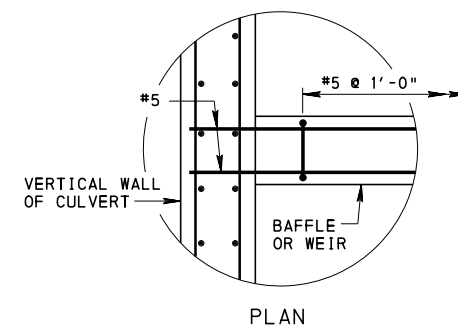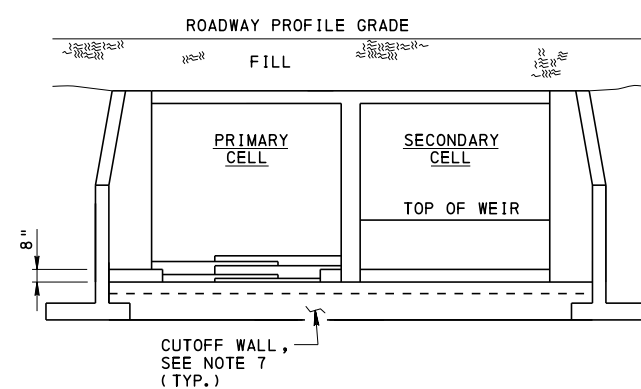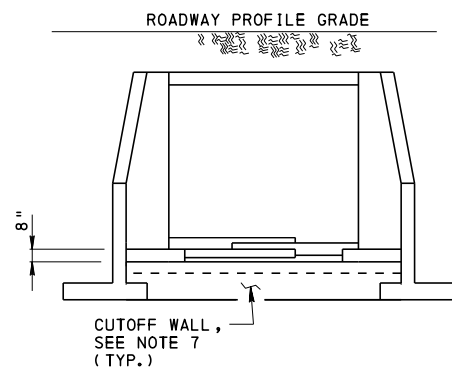


**DETAIL F**

CAST-IN-PLACE BAFFLE/WEIR REINFORCEMENT

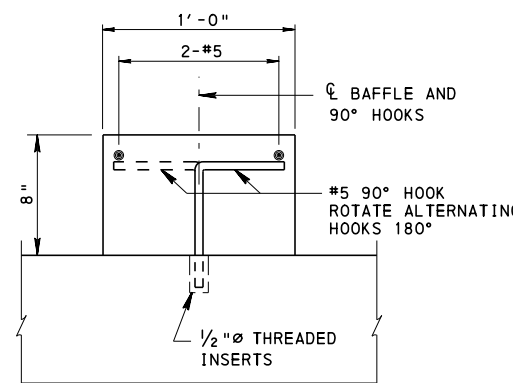

**PRECAST BOX CULVERT**

**TYPICAL BAFFLE DETAIL**

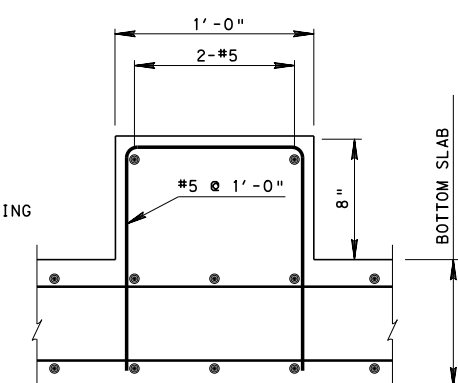

**CAST-IN-PLACE BOX CULVERT**

**ALTERNATE BAFFLE DETAIL**

## DESIGN NOTES:

1. THE BAFFLE SPACING AND OPENINGS SHOULD BE BASED ON THE NORMAL CHANNEL WIDTH UPSTREAM AND DOWNSTREAM OF THE STRUCTURE (I.E. EDGE OF WATER TO EDGE OF WATER DURING NORMAL FLOW). AT LEAST THREE (3) MEASUREMENTS SHOULD BE TAKEN UPSTREAM AND DOWNSTREAM OF THE STRUCTURE WHERE THE STREAM EXHIBITS NORMAL, STABLE CONDITIONS. AN AVERAGE OF THOSE SIX (6) MEASUREMENTS SHOULD THEN BE USED FOR THE BAFFLE CONFIGURATIONS.
  - MEASUREMENTS SHOULD NOT BE TAKEN WHERE THE CHANNEL HAS BEEN AFFECTED BY THE STRUCTURE OR SHOW SIGNS OF EROSION. BAFFLE CONFIGURATIONS SHOULD BE BASED ON NORMAL STREAM WIDTH (NOT TOP OF BANK TO TOP OF BANK OR WIDTH OF THE CULVERT).
2. THE OPENING IN THE APRON BAFFLES SHOULD BE EQUAL TO AVERAGE NORMAL WIDTH OF THE STREAM. THE APRON BAFFLES SHOULD CONNECT TO THE WINGWALLS AT EACH SIDE OF THE CULVERT. PLACE THE FIRST SET OF BAFFLES AT THE END OF THE APRON. IF THE APRON IS GREATER THAN 8'-0" LONG, A SECOND SET OF OPPOSING BAFFLES ARE REQUIRED TO BE SET AT 1/2 THE DISTANCE FROM THE END BAFFLE TO THE FACE OF THE BOX. FOR LONGER APRONS, BAFFLES NOT TO EXCEED 8'-0" SPACING.
3. THE OPENING IN THE INTERIOR BAFFLES SHOULD BE EQUAL TO 1/3 THE AVERAGE NORMAL WIDTH OF THE STREAM.
4. BAFFLES SHOULD BE SPACED AT THE AVERAGE NORMAL STREAM WIDTH OR 8', WHICHEVER IS GREATER. THE FIRST INTERIOR BAFFLE AT THE OUTLET SHOULD BE LOCATED AS CLOSE TO THE DOWNSTREAM END OF CULVERT AS POSSIBLE AND SPACED ACCORDINGLY FROM THAT POINT TO THE INLET.
5. IF BAFFLE SPACING NEEDS ADJUSTED DUE TO BOX SEGMENTS, THE SPACING SHOULD BE SHORTER NOT LONGER THAN CALCULATED SPACING.
6. THERE MAY BE UNUSUAL CIRCUMSTANCES IN WHICH THE STANDARD LAYOUT FOR BAFFLES WILL NOT ADEQUATELY ACCOMMODATE FISH PASSAGE. IN THESE CASES, THE PENNSYLVANIA FISH AND BOAT COMMISSION MUST PROVIDE SPECIFIC DESIGN GUIDANCE DURING PRELIMINARY DESIGN.
7. CUTOFF WALL IS TO ENSURE STREAMFLOW DOES NOT PASS BENEATH THE CULVERT. BOTTOM OF CUTOFF WALL IS TO EQUAL WING WALL FOOTINGS OR ROCK LINING WHICHEVER IS DEEPER 3'-6" MIN.
8. ROCK LINING AT THE INLET AND OUTLET SHOULD BE DEPRESSED THE ENTIRE LENGTH AND CHOKED WITH NATURAL STREAMBED MATERIAL. THE ROCK SHOULD BE FLUSH WITH THE CULVERT BOTTOM, NOT THE TOP OF THE BAFFLES. STREAMBED MATERIAL SALVAGED FROM EXCAVATION FOR THE BOX CULVERT SHOULD BE PLACED ON TOP OF THE ROCK LINING AND APRON TO THE MAXIMUM HEIGHT OF THE TOP OF THE BAFFLE TO THE LIMIT OF THE ROCK LINING TO FACILITATE THE DEVELOPEMENT OF A NATURAL STREAM BOTTOM IF FEASIBLE.
9. THE SLOPE OF THE NEW STRUCTURE SHOULD MATCH THE NATURAL STREAM SLOPE.
10. ADDITIONAL TWIN CELL DETAILS ARE SHOWN ON SHEET 12.
11. BAFFLES MAY BE SKEWED RELATIVE TO THE DIRECTION OF FLOW IN ORDER TO BE PARALLEL TO THE SECTION ENDS.



**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
 BUREAU OF PROJECT DELIVERY

**STANDARD**  
**R.C. BOX CULVERT**  
**MISCELLANEOUS DETAILS**  
**STREAM GRADES ≤ 4%**



RECOMMENDED AUG. 30, 2019  
*Louis J. Russo*  
 ACTING CHIEF BRIDGE ENGINEER

RECOMMENDED AUG. 30, 2019  
*Michael V. Bator*  
 ACT. DIR., BUR. OF PROJECT DELIVERY


SHEET 10 OF 15  
**BD-632M**

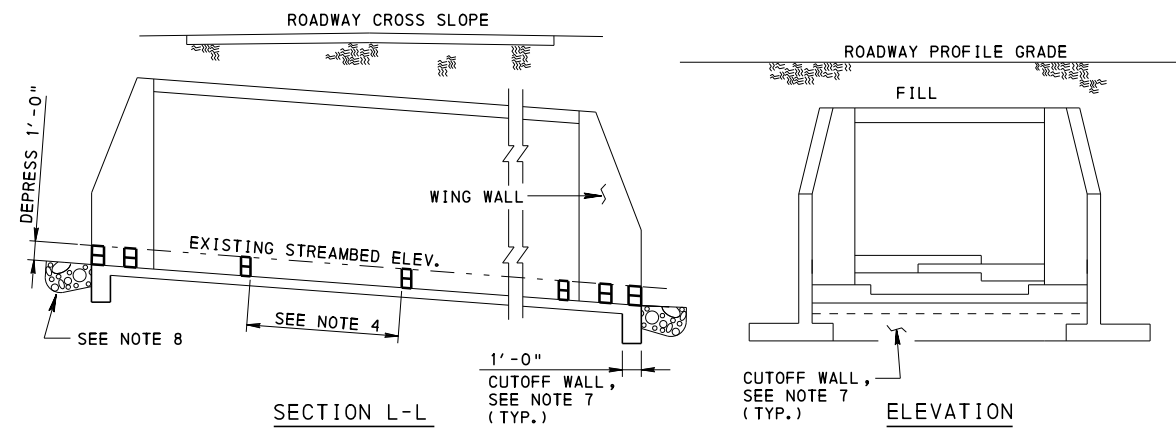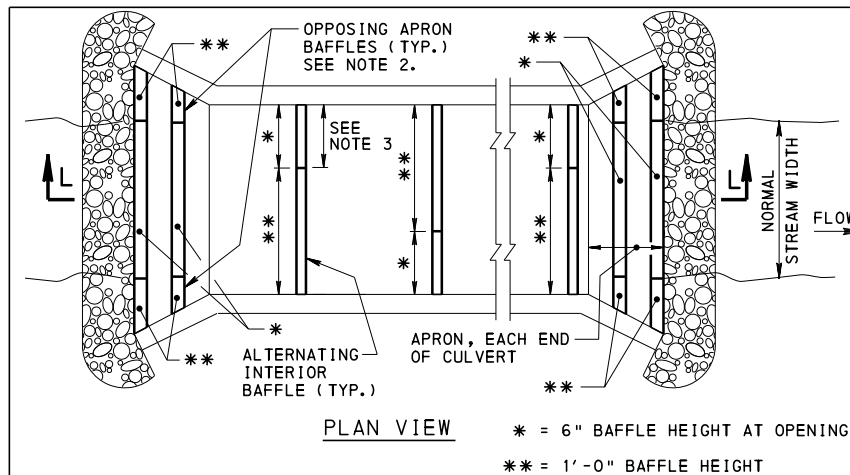

## BOX CULVERTS

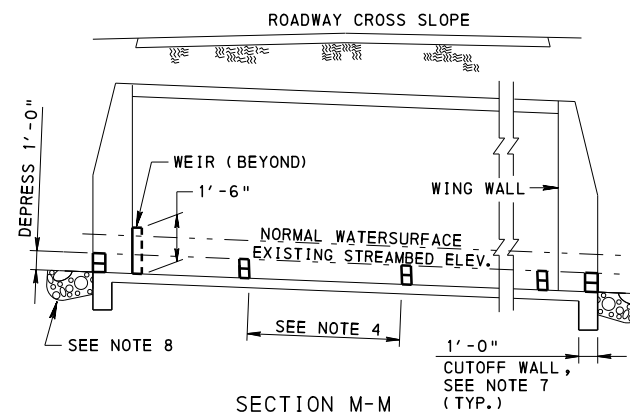
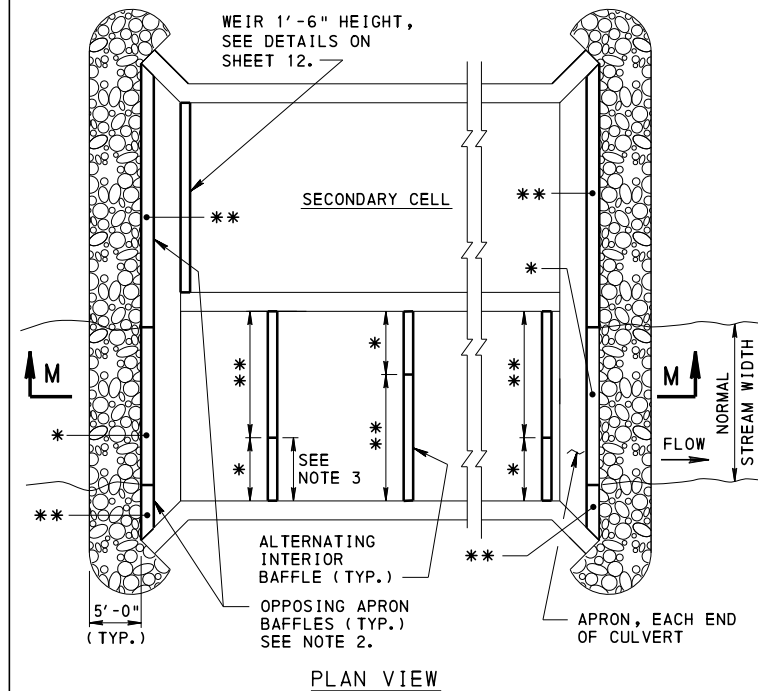


## TWIN CELL BOX CULVERTS

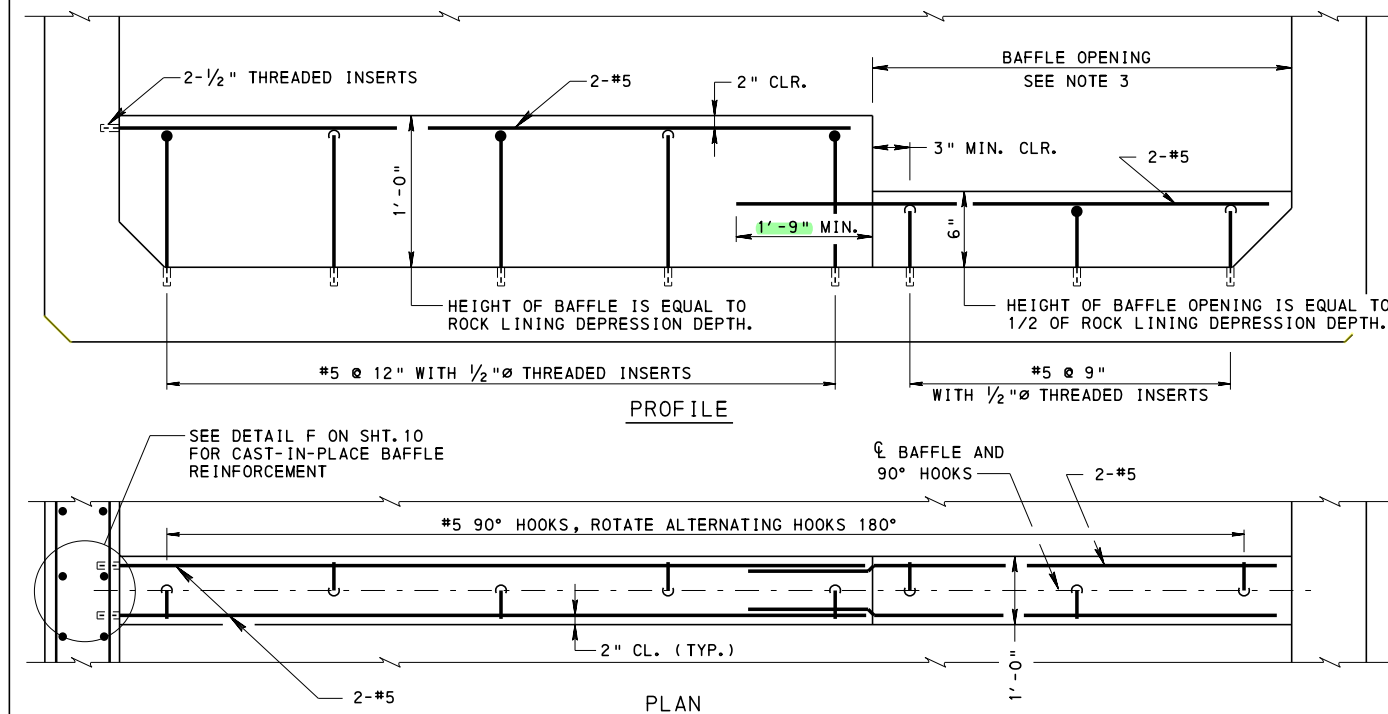


### TYPICAL INTERIOR BAFFLE

PRECAST REINFORCEMENT SHOWN, CAST-IN-PLACE REINFORCEMENT SIMILAR EXCEPT AS NOTED ON THIS STANDARD.

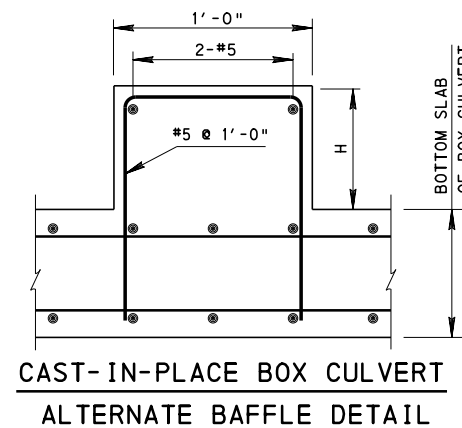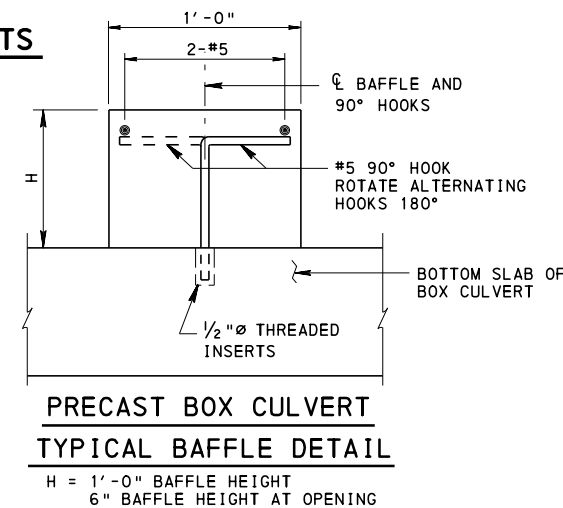

### DESIGN NOTES:

1. THE BAFFLE SPACING AND OPENINGS SHOULD BE BASED ON THE NORMAL CHANNEL WIDTH UPSTREAM AND DOWNSTREAM OF THE STRUCTURE (I.E. EDGE OF WATER TO EDGE OF WATER DURING NORMAL FLOW). AT LEAST THREE (3) MEASUREMENTS SHOULD BE TAKEN UPSTREAM AND DOWNSTREAM OF THE STRUCTURE WHERE THE STREAM EXHIBITS NORMAL, STABLE CONDITIONS. AN AVERAGE OF THOSE SIX (6) MEASUREMENTS SHOULD THEN BE USED FOR THE BAFFLE CONFIGURATIONS.
  - MEASUREMENTS SHOULD NOT BE TAKEN WHERE THE CHANNEL HAS BEEN AFFECTED BY THE STRUCTURE OR SHOW SIGNS OF EROSION. BAFFLE CONFIGURATIONS SHOULD BE BASED ON NORMAL STREAM WIDTH (NOT TOP OF BANK TO TOP OF BANK OR WIDTH OF THE CULVERT).
2. THE OPENING IN THE APRON BAFFLES SHOULD BE EQUAL TO AVERAGE NORMAL WIDTH OF THE STREAM. THE APRON BAFFLES SHOULD CONNECT TO THE WINGWALLS AT EACH SIDE OF THE CULVERT. PLACE THE FIRST SET OF BAFFLES AT THE END OF THE APRON. IF THE APRON IS GREATER THAN 8'-0" LONG, A SECOND SET OF OPPOSING BAFFLES ARE REQUIRED TO BE SET AT 1/2 THE DISTANCE FROM THE END BAFFLE TO THE FACE OF THE BOX. FOR LONGER APRONS, BAFFLES NOT TO EXCEED 8'-0" SPACING.
3. THE OPENING IN THE INTERIOR BAFFLES SHOULD BE EQUAL TO 1/3 THE AVERAGE NORMAL WIDTH OF THE STREAM.
4. BAFFLES SHOULD BE SPACED AT THE AVERAGE NORMAL STREAM WIDTH OR 8', WHICHEVER IS GREATER. THE FIRST INTERIOR BAFFLE AT THE OUTLET SHOULD BE LOCATED AS CLOSE TO THE DOWNSTREAM END OF CULVERT AS POSSIBLE AND SPACED ACCORDINGLY FROM THAT POINT TO THE INLET.
5. IF BAFFLE SPACING NEEDS ADJUSTED DUE TO BOX SEGMENTS, THE SPACING SHOULD BE SHORTER NOT LONGER THAN CALCULATED SPACING.
6. THERE MAY BE UNUSUAL CIRCUMSTANCES IN WHICH THE STANDARD LAYOUT FOR BAFFLES WILL NOT ADEQUATELY ACCOMMODATE FISH PASSAGE. IN THESE CASES, THE PENNSYLVANIA FISH AND BOAT COMMISSION MUST PROVIDE SPECIFIC DESIGN GUIDANCE DURING PRELIMINARY DESIGN.
7. CUTOFF WALL IS TO ENSURE STREAMFLOW DOES NOT PASS BENEATH THE CULVERT. BOTTOM OF CUTOFF WALL IS TO EQUAL WING WALL FOOTINGS OR ROCK LINING WHICHEVER IS DEEPER 3'-6" MIN.
8. ROCK LINING AT THE INLET AND OUTLET SHOULD BE DEPRESSED THE ENTIRE LENGTH AND CHOKED WITH NATURAL STREAMBED MATERIAL. THE ROCK SHOULD BE FLUSH WITH THE CULVERT BOTTOM, NOT THE TOP OF THE BAFFLES. STREAMBED MATERIAL SALVAGED FROM EXCAVATION FOR THE BOX CULVERT SHOULD BE PLACED ON TOP OF THE ROCK LINING AND APRON TO THE MAXIMUM HEIGHT OF THE TOP OF THE BAFFLE TO THE LIMIT OF THE ROCK LINING TO FACILITATE THE DEVELOPEMENT OF A NATURAL STREAM BOTTOM IF FEASIBLE.
9. THE SLOPE OF THE NEW STRUCTURE SHOULD MATCH THE NATURAL STREAM SLOPE.
10. ADDITIONAL TWIN CELL DETAILS ARE SHOWN ON SHEET 12.
11. BAFFLES MAY BE SKEWED RELATIVE TO THE DIRECTION OF FLOW IN ORDER TO BE PARALLEL TO THE SECTION ENDS.

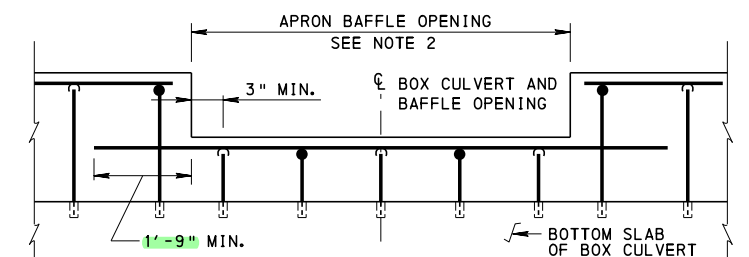

### APRON BAFFLE OPENING DETAIL

APRON BAFFLE TYPICAL TO INTERIOR BAFFLE EXCEPT WHERE NOTED OTHERWISE.


**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
 BUREAU OF PROJECT DELIVERY

STANDARD  
 R.C. BOX CULVERT  
 MISCELLANEOUS DETAILS  
 STREAM GRADES > 4%

RECOMMENDED AUG. 30, 2019  
 ACTING CHIEF BRIDGE ENGINEER


RECOMMENDED AUG. 30, 2019  
 ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 11 OF 15  
 BD-632M

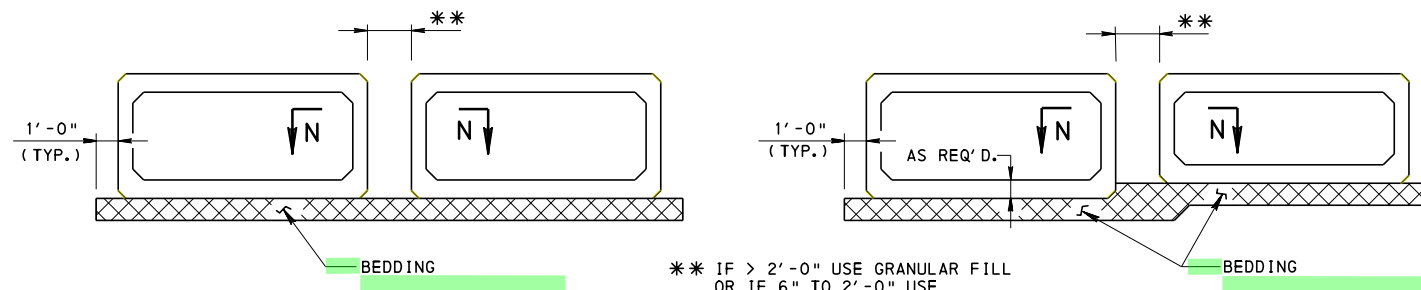


**TYP. PRECAST SECTION (NORMAL)**  
SYMMETRICAL


**TYP. PRECAST SECTION (NORMAL)**  
UNSYMMETRICAL - OPTION TO WEIR

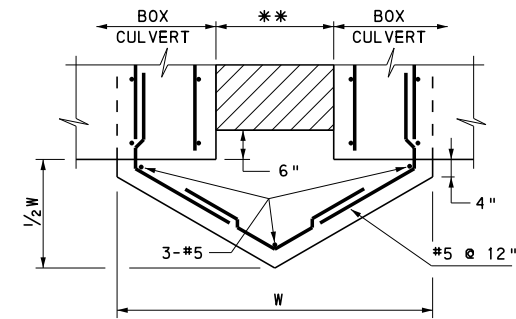


**SECTION N-N**  
CONCRETE PLUG

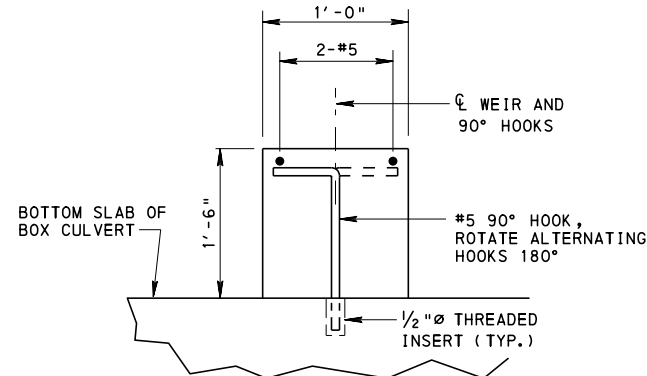


**PRECAST BOX CULVERT**  
**TYPICAL WEIR DETAIL**  
ALL STREAM GRADES

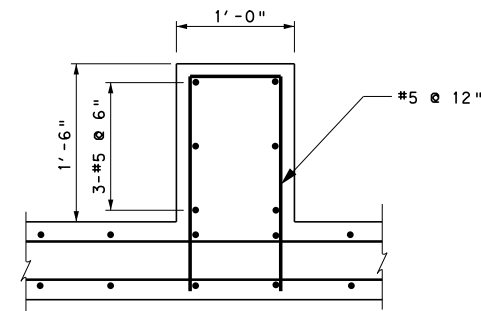

**CAST-IN-PLACE BOX CULVERT**  
**ALTERNATE WEIR DETAIL**  
ALL STREAM GRADES

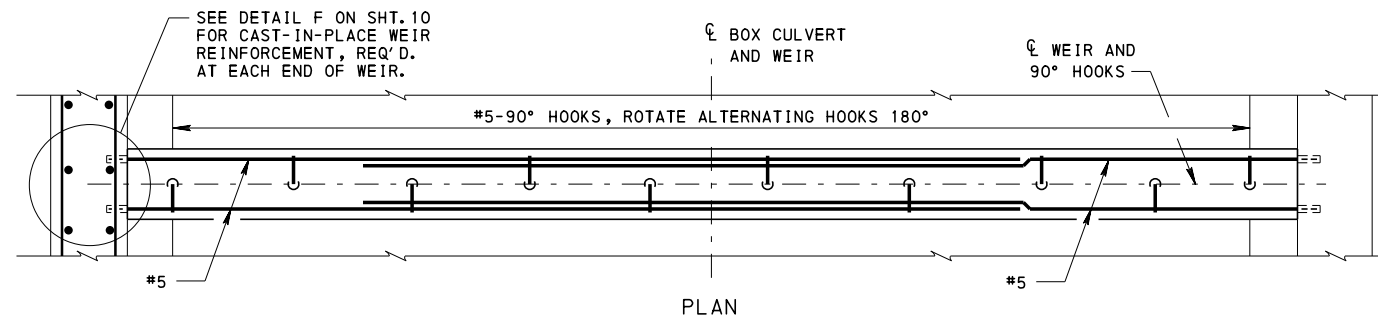

**PLAN**

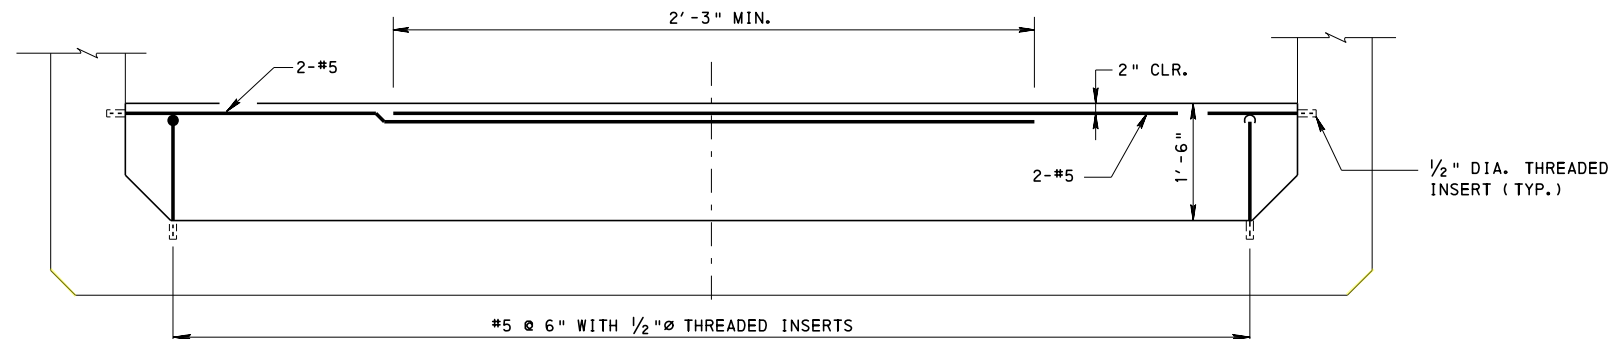

**PROFILE**

**WEIR DETAIL**

PRECAST REINFORCEMENT SHOWN, CAST-IN-PLACE REINFORCEMENT  
SIMILAR EXCEPT AS NOTED ON THIS STANDARD.


DESIGN NOTE:  
THERE MAY BE UNUSUAL CIRCUMSTANCES IN WHICH THE STANDARD LAYOUT FOR BAFFLES  
WILL NOT ADEQUATELY ACCOMMODATE FISH PASSAGE. IN THESE CASES, THE PENNSYLVANIA  
FISH AND BOAT COMMISSION MUST PROVIDE SPECIFIC DESIGN GUIDANCE DURING  
PRELIMINARY DESIGN.

**COMMONWEALTH OF PENNSYLVANIA**  
**DEPARTMENT OF TRANSPORTATION**  
BUREAU OF PROJECT DELIVERY



**STANDARD**  
**R.C. BOX CULVERT**  
**MISCELLANEOUS TWIN CELL DETAILS**

RECOMMENDED AUG. 30, 2019 <i>John J. Ringer</i> ACTING CHIEF BRIDGE ENGINEER	RECOMMENDED AUG. 30, 2019 <i>Mark V. Bate</i> ACT. DIR., BUR. OF PROJECT DELIVERY	SHEET 12 OF 15 <b>BD-632M</b>
------------------------------------------------------------------------------------	-----------------------------------------------------------------------------------------	----------------------------------




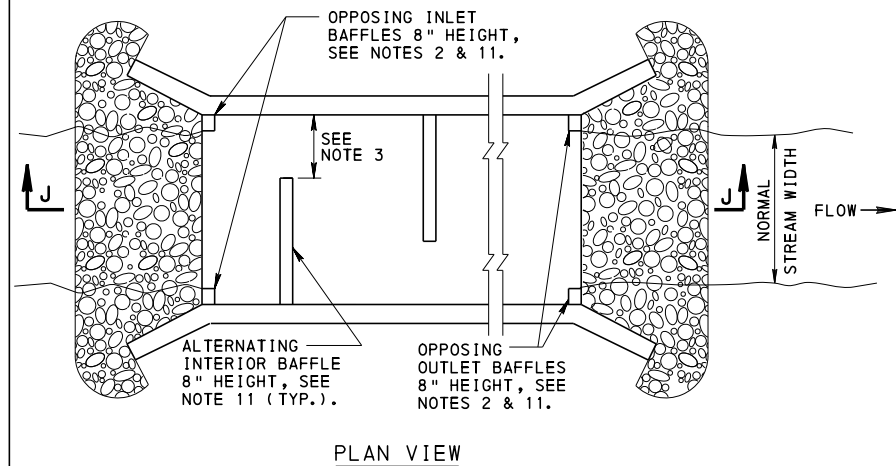


NOTE: TOP OF BAFFLE SHALL BE MIN. 4" BELOW EXIST. STREAMBED ELEV.

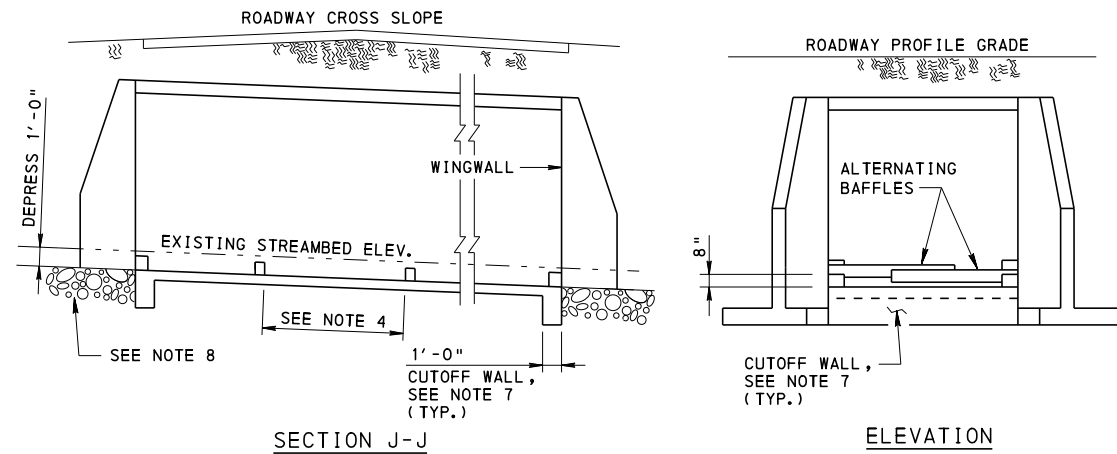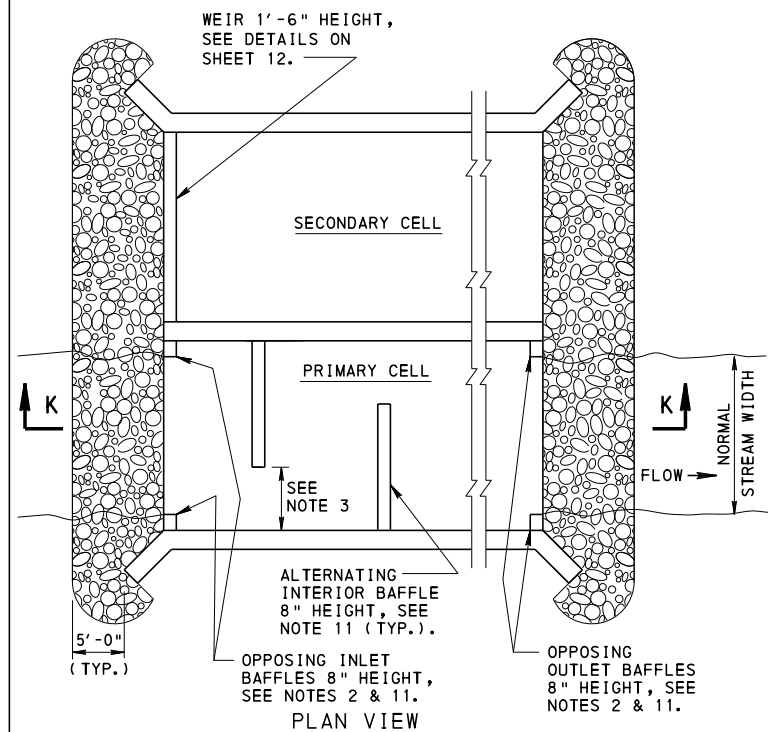

### BOX CULVERTS

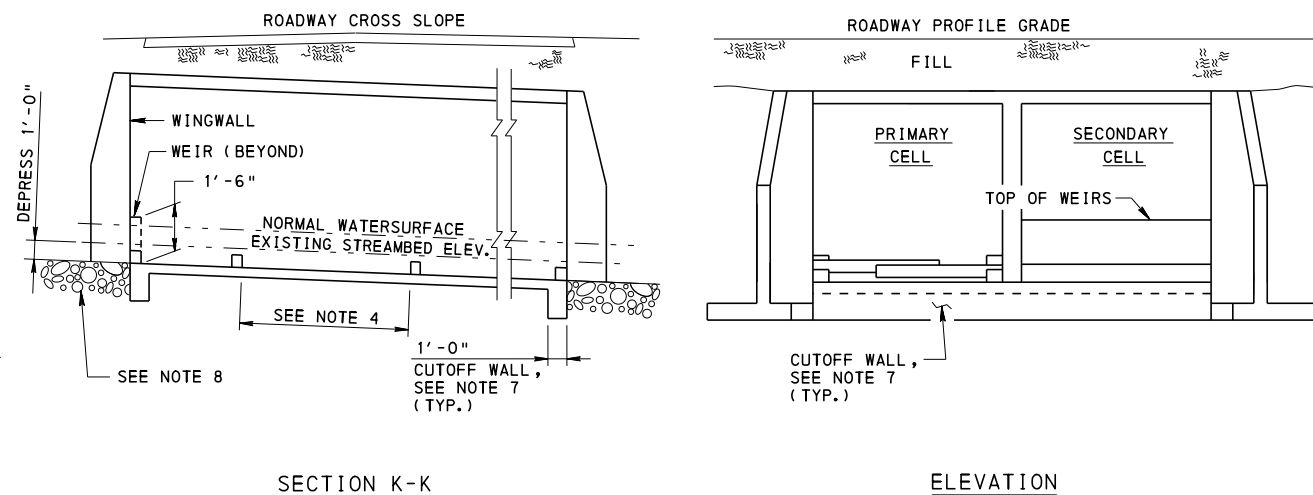


### TWIN CELL BOX CULVERTS

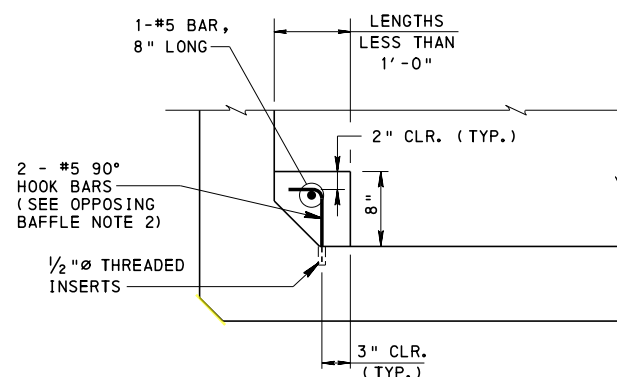

OPPOSING BAFFLES LESS THAN 1'-0"

#### OPPOSING BAFFLE NOTES:

1. PRECAST REINFORCEMENT SHOWN, CAST-IN-PLACE REINFORCEMENT SIMILAR EXCEPT AS NOTED ON SHEET 10.
2. FOR OPPOSING BAFFLES LESS THAN 1'-0", CAST ADJACENT INSERTS 7" ON CENTER FOR THE 2 - #5 90° HOOK BARS.
3. FOR OPPOSING BAFFLES LESS THAN 2'-0", REPLACE 2-#5 BARS WITH A #5 U-BAR SUPPORTED BY 8" LONG #5 BARS TIED TO ALTERNATING #5 90° HOOK BARS.

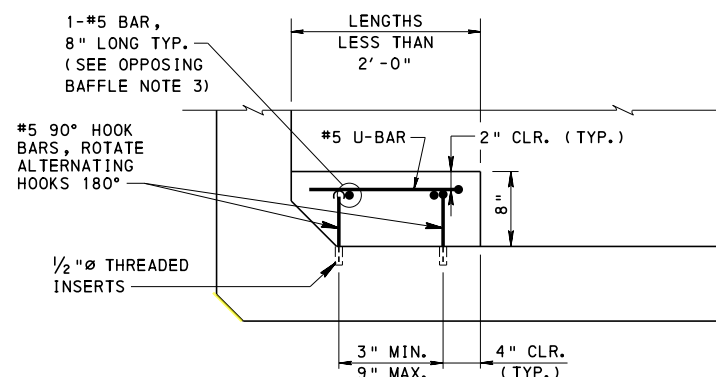

OPPOSING BAFFLES LESS THAN 2'-0"

#### DESIGN NOTES:

1. THE BAFFLE SPACING AND OPENINGS SHOULD BE BASED ON THE NORMAL CHANNEL WIDTH UPSTREAM AND DOWNSTREAM OF THE STRUCTURE (I.E. EDGE OF WATER TO EDGE OF WATER DURING NORMAL FLOW). AT LEAST THREE (3) MEASUREMENTS SHOULD BE TAKEN UPSTREAM AND DOWNSTREAM OF THE STRUCTURE WHERE THE STREAM EXHIBITS NORMAL, STABLE CONDITIONS. AN AVERAGE OF THOSE SIX (6) MEASUREMENTS SHOULD THEN BE USED FOR THE BAFFLE CONFIGURATIONS.
  - MEASUREMENTS SHOULD NOT BE TAKEN WHERE THE CHANNEL HAS BEEN AFFECTED BY THE STRUCTURE OR SHOW SIGNS OF EROSION. BAFFLE CONFIGURATIONS SHOULD BE BASED ON NORMAL STREAM WIDTH (NOT TOP OF BANK TO TOP OF BANK OR WIDTH OF THE CULVERT).
2. OPPOSING BAFFLES SHOULD BE PLACED AT THE INLET AND THE OUTLET ENDS OF THE CULVERT. THE BAFFLE OPENING SHOULD BE A DISTANCE EQUAL TO THE AVERAGE NORMAL WIDTH OF THE STREAM.
3. THE OPENING IN THE INTERIOR BAFFLES SHOULD BE A DISTANCE EQUAL TO 1/3 THE AVERAGE NORMAL WIDTH OF THE STREAM.
4. INTERIOR BAFFLES SHOULD BE SPACED AT A DISTANCE EQUAL TO THE AVERAGE NORMAL STREAM WIDTH OR 8', WHICHEVER IS GREATER AND BE SPACED EVENLY BETWEEN THE INLET AND OUTLET BAFFLES.
5. IF BAFFLE SPACING NEEDS ADJUSTED DUE TO BOX SEGMENTS, THE SPACING SHOULD BE SHORTER NOT LONGER THAN CALCULATED SPACING.
6. THERE MAY BE UNUSUAL CIRCUMSTANCES IN WHICH THE STANDARD LAYOUT FOR BAFFLES WILL NOT ADEQUATELY ACCOMMODATE FISH PASSAGE. IN THESE CASES, THE PENNSYLVANIA FISH AND BOAT COMMISSION MUST PROVIDE SPECIFIC DESIGN GUIDANCE DURING PRELIMINARY DESIGN.
7. CUTOFF WALL IS TO ENSURE STREAMFLOW DOES NOT PASS BENEATH THE CULVERT. BOTTOM OF CUTOFF WALL IS TO EQUAL WING WALL FOOTINGS OR ROCK LINING WHICHEVER IS DEEPER 3'-6" MIN.
8. ROCK LINING AT THE INLET AND OUTLET SHOULD BE DEPRESSED THE ENTIRE LENGTH AND CHOKED WITH NATURAL STREAMBED MATERIAL. THE ROCK SHOULD BE FLUSH WITH THE CULVERT BOTTOM, NOT THE TOP OF THE BAFFLES. STREAMBED MATERIAL SALVAGED FROM EXCAVATION FOR THE BOX CULVERT SHOULD BE PLACED ON TOP OF THE ROCK LINING TO THE MAXIMUM HEIGHT OF THE TOP OF THE BAFFLE TO THE LIMIT OF THE ROCK LINING TO FACILITATE THE DEVELOPEMENT OF A NATURAL STREAM BOTTOM IF FEASIBLE.
9. THE SLOPE OF THE NEW STRUCTURE SHOULD MATCH THE NATURAL STREAM SLOPE.
10. ADDITIONAL TWIN CELL DETAILS ARE SHOWN ON SHEET 12.
11. FOR TYPICAL BAFFLE PLAN, PROFILE AND REINFORCEMENT DETAILS, SEE SHEET 10.

COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R.C. BOX CULVERT WITHOUT APRONS  
MISCELLANEOUS DETAILS  
STREAM GRADES ≤ 4%

RECOMMENDED AUG. 30, 2019  
*James J. Ringer*  
ACTING CHIEF BRIDGE ENGINEER


RECOMMENDED AUG. 30, 2019  
*Michael J. Biele*  
ACT. DIR., BUR. OF PROJECT DELIVERY

SHEET 13 OF 15  
BD-632M


DESIGN INSTRUCTIONS:

	SKEWED JOINT OPTION **		SQUARED JOINT OPTION **
	CULVERT SKEW $\geq 75^\circ$	CULVERT SKEW $< 75^\circ$	ALL CULVERT SKEWS
	CULVERT SKEW $\geq 75^\circ$	OPTION 1 **	OPTION 2 **
INTERMEDIATE SEGMENTS	WALL FACES, TOP SLAB FACES AND BOTTOM FACES ALONG THE JOINT ARE SKEWED WITH CULVERT SKEW ANGLE.	WALL FACES ARE SQUARED OFF ALONG JOINT. TOP SLAB FACES AND BOTTOM FACES ALONG THE JOINT ARE SKEWED WITH CULVERT SKEW ANGLE.	WALL FACES, TOP SLAB FACES AND BOTTOM FACES <del>ALONG THE JOINT</del> ARE SQUARED OFF ALONG JOINT.
END SEGMENTS	WALL FACES, TOP SLAB FACES AND BOTTOM FACES ALONG THE JOINT ARE SKEWED WITH CULVERT SKEW ANGLE.	WALL FACES ARE SQUARED OFF ALONG JOINT. TOP SLAB FACES AND BOTTOM FACES ALONG THE JOINT ARE SKEWED WITH CULVERT SKEW ANGLE.	WALL FACES, TOP SLAB FACES AND BOTTOM FACES <del>ALONG THE JOINT</del> ARE SKEWED WITH CULVERT SKEW ANGLE. WALL FACES, TOP SLAB FACES AND BOTTOM FACES AT END SECTION SIDE ARE SKEWED WITH CULVERT SKEW ANGLE.


\*\* TO BE DETERMINED BY DISTRICT ENGINEER. AT SHOP DRAWING STAGE, FABRICATOR MAY SUBMIT ANY OPTION ON THIS STANDARD. IF THE OPTION SUBMITTED MEETS THE DESIGN, THE OPTION SHOULD BE ACCEPTED.

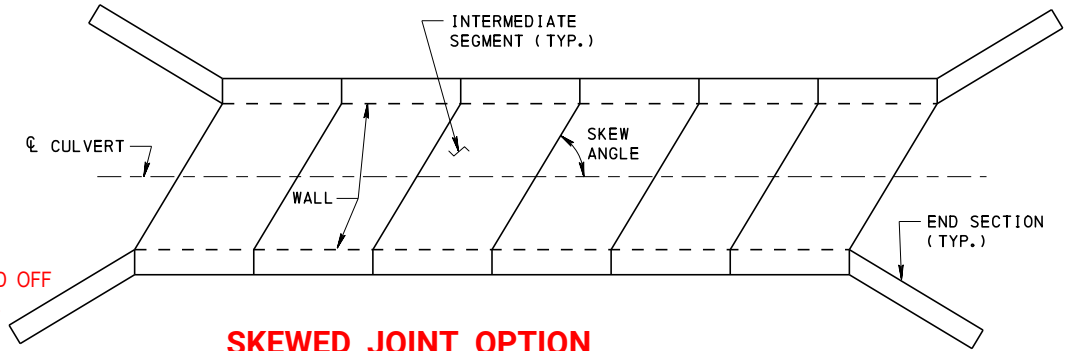

**SKEWED JOINT OPTION**  
**SKEW ANGLE  $< 75$  DEGREES ~~OPTION 1~~**

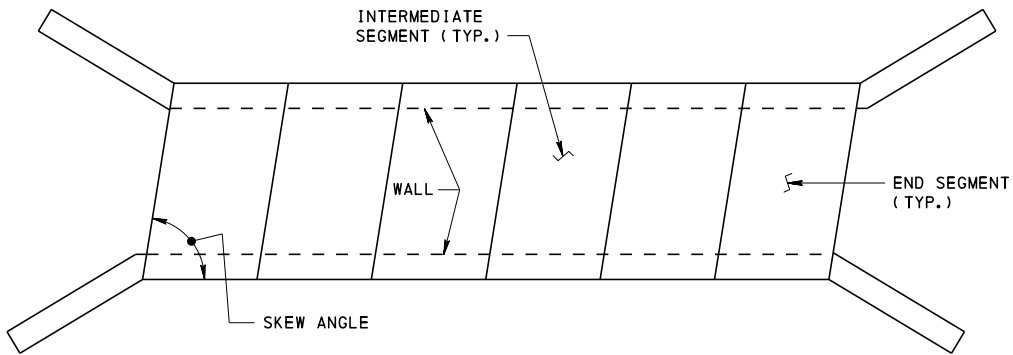


**SKEWED JOINT OPTION**  
**SKEW ANGLE  $\geq 75$  DEGREES**

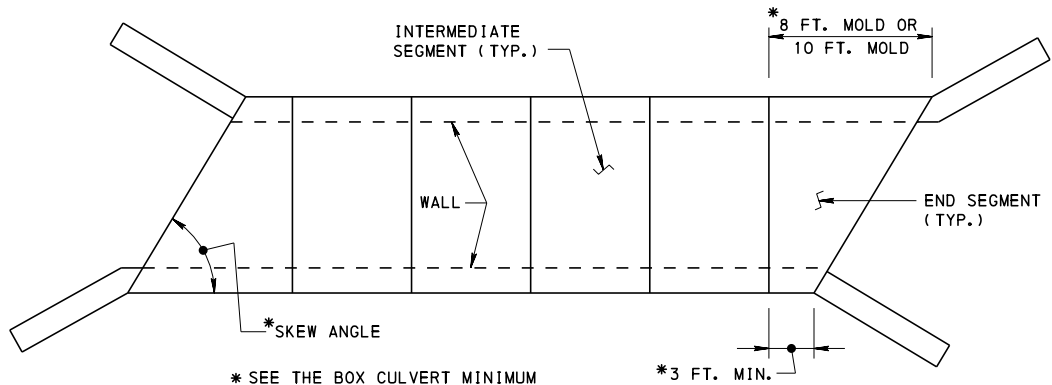

**~~SKEW ANGLE  $< 75$  DEGREES OPTION 2~~**  
**SQUARED JOINT OPTION (ALL SKEW ANGLES)**

DESIGN EXAMPLE:


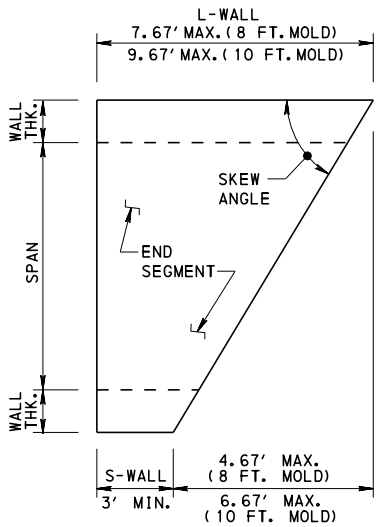


**BOX CULVERT (STEEL FORM) - MINIMUM SKEW ANGLE**  
(MOLD SIZES 8 FT. AND 10 FT.)

SPAN-INT. = 10 FT. (NORMAL INTERIOR CLEAR SPAN OF CULVERT)  
WALL = 12 IN. (WALL THICKNESS OF CULVERT)  
SPAN-EXT. = SPAN-INT + 2 x WALL (NORMAL EXTERIOR WIDTH OF CULVERT)  
S-WALL = 3 FT. (MINIMUM EXTERIOR SHORT WALL LENGTH OF CULVERT UNIT)  
MOLD = { 8 FT. (STANDARD MAXIMUM STEEL FORMING SYSTEM HEIGHTS)  
10 FT.  
L-WALL = MOLD - 4 IN. (MAXIMUM EXTERIOR LONG WALL LENGTH ALLOWING FOR RAMP FORMING)  
L-WALL = { 7.667 FT.  
9.667 FT.  
SKEW-MIN. =  $90 - \text{ATAN}((L\text{-WALL} - S\text{-WALL}) / \text{SPAN-EXT.})$   
L-WALL = { 68.75 DEGREES (MIN. SKEW ANGLE FOR 8 FT. MOLD AND 10 FT. MOLD RESPECTIVELY)  
60.95 DEGREES



COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
R.C. BOX CULVERT  
PRECAST CONCRETE  
SEGMENT JOINT DETAILS

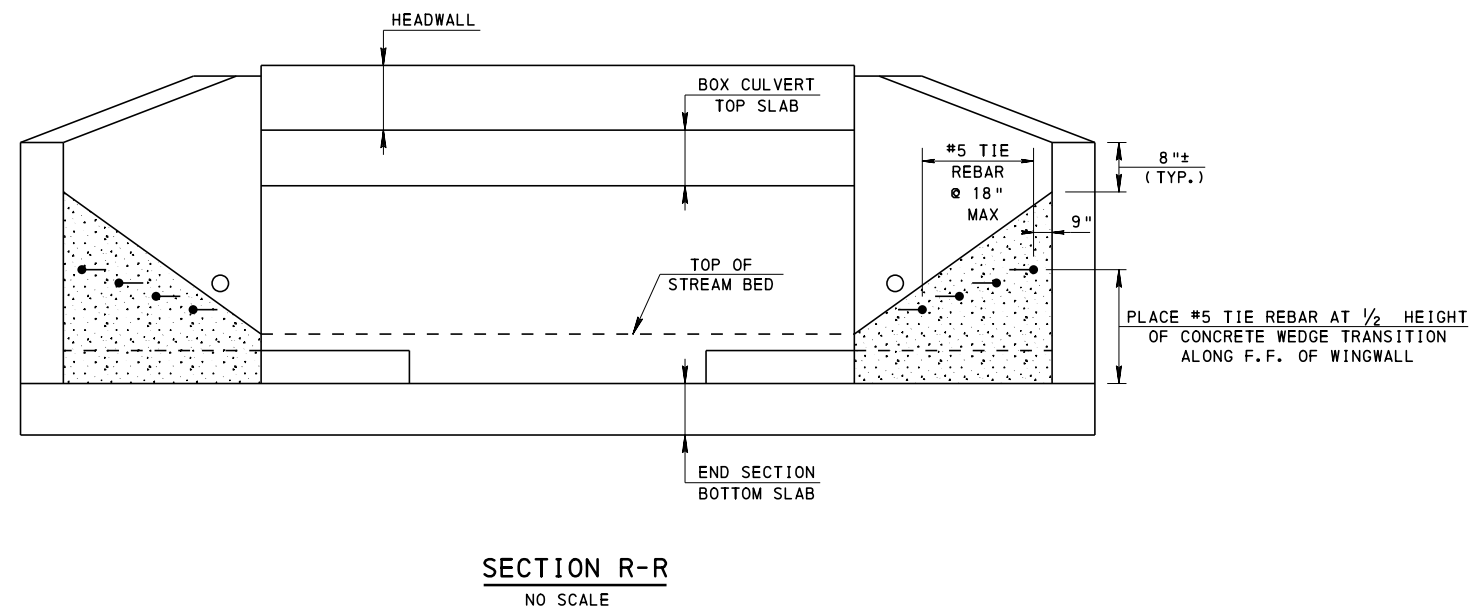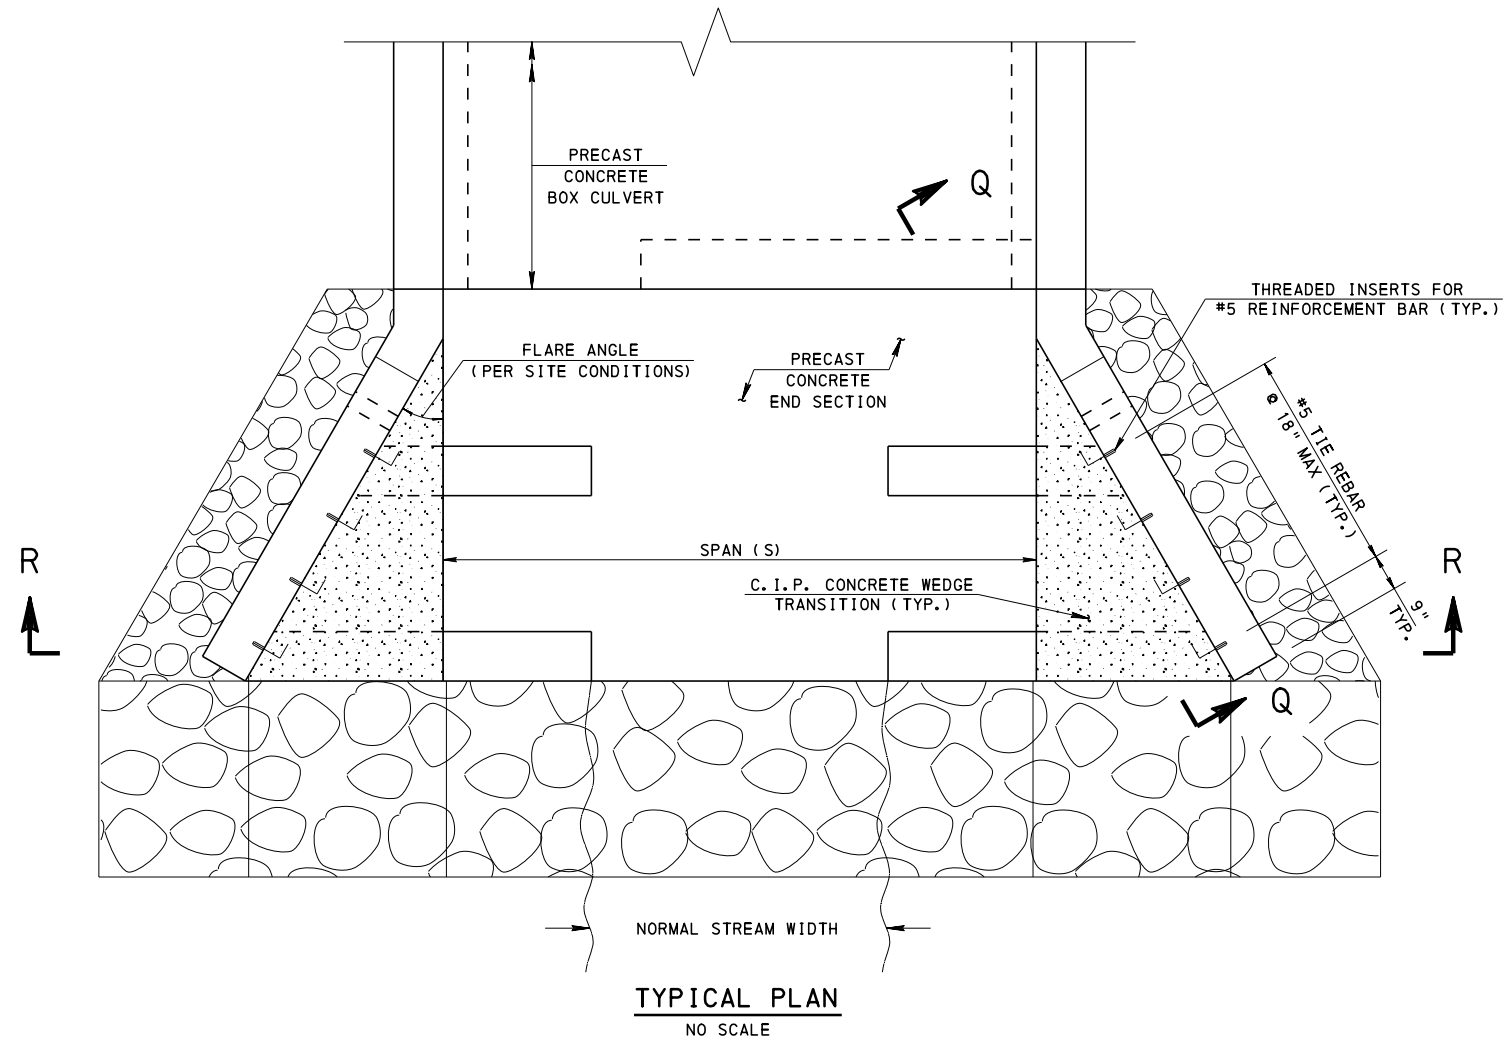

#### DESIGN NOTES:

1. THE LAYOUT OF THE CONCRETE SLOPE TRANSITIONS SHOULD BE BASED ON THE REQUIRED GRADING AROUND THE WING WALLS.
2. CONSTRUCT CONCRETE SLOPE TRANSITIONS USING CLASS A CEMENT CONCRETE.
3. USE THIS DETAIL IN COORDINATE WITH DEP AND PAFBC DURING PRE-APP MEETING

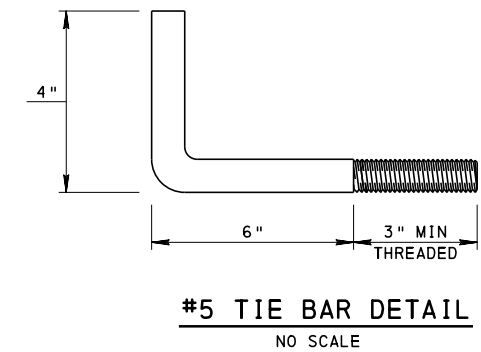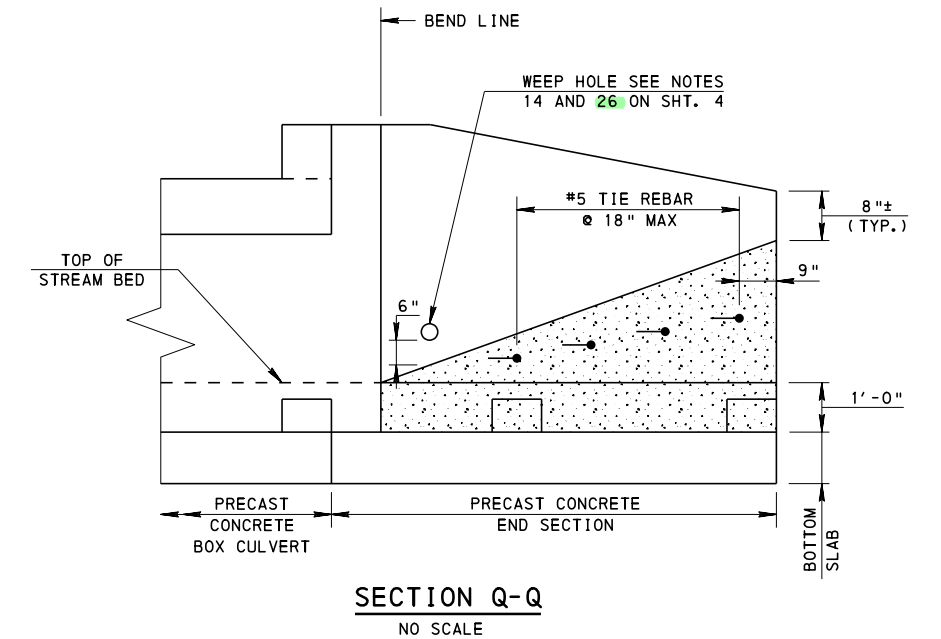

COMMONWEALTH OF PENNSYLVANIA  
DEPARTMENT OF TRANSPORTATION  
BUREAU OF PROJECT DELIVERY

STANDARD  
PRECAST BOX CULVERT WITH APRONS  
C. I. P CONCRETE WEDGE  
TRANSITION

RECOMMENDED AUG. 30, 2019 <i>Louis J. Russo</i> ACTING CHIEF BRIDGE ENGINEER	RECOMMENDED AUG. 30, 2019 <i>Michael J. Bilek</i> ACT. DIR., BUR. OF PROJECT DELIVERY	SHEET 15 OF 15 BD-632M
---------------------------------------------------------------------------------------	------------------------------------------------------------------------------------------------	---------------------------